

KADIR HAS UNIVERSITY
GRADUATE SCHOOL OF SCIENCE AND ENGINEERING



ELECTRICITY DEMAND AND SUPPLY SCENARIO ANALYSIS FOR
NIGERIA USING LONG RANGE ENERGY ALTERNATIVES PLANNING

GRADUATE THESIS

HANIF AUWAL IBRAHIM

JULY, 2017


Hanif Auwal Ibrahim

M.Sc. Thesis

2017

ELECTRICITY DEMAND AND SUPPLY SCENARIO ANALYSIS FOR
NIGERIA USING LONG RANGE ENERGY ALTERNATIVES PLANNING

HANIF AUWAL IBRAHIM

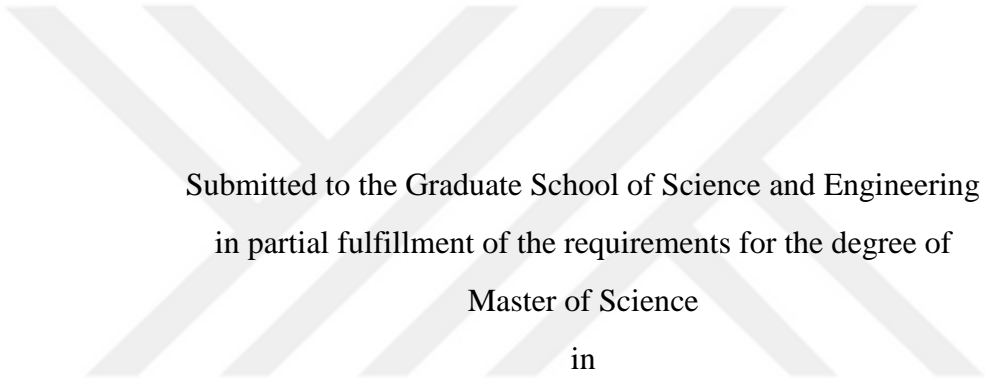

Submitted to the Graduate School of Science and Engineering
in partial fulfillment of the requirements for the degree of
Master of Science
in
INDUSTRIAL ENGINEERING

KADIR HAS UNIVERSITY

JULY, 2017

KADIR HAS UNIVERSITY GRADUATE SCHOOL OF SCIENCE AND
ENGINEERING

ELECTRICITY DEMAND AND SUPPLY SCENARIO ANALYSIS FOR
NIGERIA USING LONG RANGE ENERGY ALTERNATIVES PLANNING

HANIF AUWAL IBRAHIM

APPROVED BY:

Asst. Prof. Gökhan KIRKİL (Advisor)

Asst. Prof. Emre ÇELEBİ (Jury member)

Asst. Prof. Murat KÜÇÜKVAR (Jury member)



APPROVAL DATE: 7 JULY, 2017

“I, HANIF AUWAL IBRAHIM, confirm that the work presented in this thesis is my own. Where information has been derived from other sources, I confirm that this has been indicated in the thesis.”



HANIF AUWAL IBRAHIM

ELECTRICITY DEMAND AND SUPPLY SCENARIO ANALYSIS FOR NIGERIA USING LONG RANGE ENERGY ALTERNATIVES PLANNING

ABSTRACT

Electricity demand and supply forecasts are very important tools for determining solutions to the problems in the electricity sector such as power outages. The Long Range Energy Alternatives Planning (LEAP) energy model was used for this study because of its low data requirements. The forecast for electricity demand and supply for Nigeria was carried out from 2010-2040. Three scenarios were generated which include Business as Usual (BAU), Energy Conservation (EC) and Renewable Energy (REN). The three scenarios were analyzed based on their electricity demand and supplies, environmental impact and costs. The BAU scenario assumed that trends in the future will follow past trends. The EC scenario was generated based on efficient usage of electricity and reduction of transmission and distribution losses. In the EC scenario, efficient electrical appliances will phase out the non-efficient ones, which reduced the electricity demand significantly. On the other hand, the REN scenario is based on the concept of harnessing renewable energy resources such as wind, solar, hydro, and biomass for electricity generation. Results of the cost analysis of the three scenarios shows that the most competitive scenario in terms of cost is the EC scenario, which has the least capital cost (44.2 billion USD less than the BAU scenario) and fixed costs (15 billion USD less than the BAU scenario) of the three scenarios but has the second largest quantity of Green House Gas (GHG) emissions of 1,004.8 million tons of CO₂eq. The REN scenario has the least GHG emissions among the three scenarios at 114.79 million tons of CO₂eq but is the most expensive scenario to implement because of its high capital (56.3 billion USD more the BAU) and fixed costs (4.1 billion USD more than the BAU scenario). The EC scenario has 28.96 % less carbon emissions than the BAU scenario (1,414.5 million tons of CO₂eq) and has the least cost among the three scenarios. As a result of the current economic challenge faced by Nigeria and a growing electricity demand, the EC scenario is the most realistic and suitable scenario to be implemented among the scenarios that were generated.

Keywords: LEAP model, energy conservation, renewable energy, greenhouse gas emissions, cost analysis, energy modelling, scenario analysis.

ELECTRICITY DEMAND AND SUPPLY SCENARIO ANALYSIS FOR NIGERIA USING LONG RANGE ENERGY ALTERNATIVES PLANNING

ÖZET

Elektrik arz ve talebi tahmini, elektrik kesintileri gibi elektrik sektöründeki sorunların çözümünde çok önemli bir araçtır. Bu çalışmada düşük veri gereksinimleri nedeniyle uzun vadeli enerji planlama sistemi olan LEAP modeli ile Nijerya için 2010-2040 yılları arasında elektrik arz ve talep tahminleri gerçekleştirilmiştir. Normal Gelişim (BAU), Enerji Korunumu (EC) ve Yenilenebilir Enerji (REN) olacak şekilde üç senaryo incelendi. Bu üç senaryo, elektrik arz ve talebi, çevreye olan etkileri ve maliyetleri açısından incelendi. BAU senaryosu, gelecekteki eğilimlerin geçmişteki eğilimleri izleyeceğini varsaymıştır. EC senaryosu, elektriğin verimli kullanılması ve iletim ve dağıtım kayıplarının azaltılması üzerine kurulmuştur. EC senaryosunda, verimli elektrik aletleri verimsizlerin yerine geçerek elektrik talebini önemli ölçüde azaltacaklardır. Diğer taraftan, REN senaryosu rüzgar, güneş, hidro ve biyoenerji gibi yenilenebilir enerji kaynaklarındaki çeşitliliğe bağlı elektrik üretimi üzerine kurulmuştur. Bu üç senaryonun sonuçları analiz edildiğinde, maliyetler açısından en rekabetçi senaryo, en düşük yatırım maliyetine (BAU senaryosundan 44.2 milyar dolar daha düşük) ve sabit gidere (BAU senaryosundan 15 milyar dolar daha düşük) sahip olan EC senaryosudur. EC senaryosu aynı zamanda 1004.8 milyon ton eşdeğer CO₂ ile en çok sera gazı emisyonuna (GHG) sahip ikinci senaryodur. REN senaryosu, üç senaryo arasından 134.62 milyon ton eşdeğer CO₂ ile en az GHG emisyonu miktarına sahip ama yüksek yatırım maliyeti (BAU senaryosundan 56.3 milyar dolar daha yüksek) ve yüksek sabit gideri (BAU senaryosundan 4.1 milyar dolar daha yüksek) ile en pahalı olan senaryodur. EC senaryosu, BAU senaryosuna göre yüzde 28.96 daha az karbon emisyonuna sahip (1,414.5 milyon ton eşdeğer CO₂), üç senaryo arasında en düşük maliyetli senaryodur. Nijerya'nın karşı karşıya bulunduğu ekonomik büyüme ve artmakta olan elektrik talebi gözönüne alındığında, EC senaryosu üretilen senaryolar arasında en gerçekçi ve uygulaması en uygun senaryo olarak gözükmektedir.

Anahtar Kelimeler: LEAP modeli, enerji tasarrufu, yenilenebilir enerji, sera gazı emisyonları, maliyet analizi, enerji modellemesi, senaryo analizi

Acknowledgement

First of all, I would like to express my sincere gratitude to my advisor Asst. Prof. Gokhan Kirkil for the continuous support of my M.Sc. study and research, for his patience, motivation, enthusiasm, and immense knowledge. His guidance helped me in all the time of research and writing of this thesis. I could not have imagined having a better advisor and mentor for my M.Sc. study.

I would also like to express my utmost gratitude to my family especially my father Honorable Justice Auwal Ibrahim (Ph.D) and mother Hajiya Fatima Ibrahim for their moral and financial support during my entire studies.

I would also like to thank my great friends, Umar Faruq Dahiru, Usman Said Sufi, Muhammed Gaddafi Ya'u, Abdullahi Muhammed Kabir, and Alqasim Ahmad for their moral support during my studies.

Table of Contents

ABSTRACT.....	iii
ÖZET.....	iv
Acknowledgement.....	v
Table of Contents.....	vi
List of Tables.....	xi
Chapter 1	1
Introduction.....	1
1.1 Statement.....	1
1.2 Scope and Outline of the Study	2
1.3 Literature Review	3
1.4 Materials and Methods	5
Chapter 2	6
Overview of the Energy Sector and Electricity Infrastructure in Nigeria.....	6
2.1 Primary Energy Supply and Consumption Situation in Nigeria.....	6
2.1.2 Energy Resources and Reserves	7
2.1.2.1. Oil.....	7
2.1.2.2. Coal	8
2.1.2.3. Natural Gas.....	9
2.1.2.4. Uranium	9
2.1.2.5. Biomass/Biofuels	9
2.1.2.6. Renewable Energy	10
2.1.3 Primary Energy Supplies	12
2.1.4 Final Energy Consumption	13
2.2 Overview of the Nigerian Electricity Sector	14
2.2.1 Electricity Generation in Nigeria.....	14
2.2.2 Electricity Transmission in Nigeria.....	15

2.2.3 Electricity Distribution in Nigeria	16
Chapter 3	18
Methodology	18
3.1 The LEAP Model.....	18
3.2 LEAP Algorithm.....	18
3.2.1 Energy Consumption	18
3.2.2 Carbon Emission.....	19
3.2.3 Costs.....	19
3.3 Nigeria’s LEAP Tree Diagram.....	19
3.4 Load Duration Curve.....	21
3.5 Data collection and Scenario Design.....	22
3.5.1 National Renewable Energy and Energy Efficiency Policy (NREEP, 2015)	22
3.5.1.1 Renewable Energy Targets Set by (NREEP, 2015)	23
3.5.2 The Renewable Energy Master Plan (REMP, 2013).....	23
3.5.3 Sustainable Energy for All Action Agenda (SE4ALL-AA, 2016) Adopted by (Inter-Ministerial Committee on Renewable Energy and Energy Efficiency ICREEE)	24
3.6 Data Used in LEAP	24
3.6.1 Demographic and Economic Data	24
3.6.2 Energy Demand Data Used in LEAP	25
3.6.3 Emission Data Used in LEAP.....	26
3.6.4 Transformation Data	27
3.6.5 Fuel Costs	28
3.7 BAU, EC, and REN Scenarios Design	29
3.7.1 BAU Scenario	29
3.7.2 EC Scenario	29
3.7.3 REN Scenario	30

Chapter 4	31
Results and Discussions	31
4.1 Electricity Demand Projections.....	31
4.2 Electricity Supply Projections	34
4.2.1 BAU Electricity Supply	34
4.2.2 REN Electricity Supply	36
4.2.3 EC Electricity Supply	38
4.3 GHG Emission Analysis.....	40
4.4 Cost Analysis of BAU, EC and REN Scenarios	42
Chapter 5	45
Conclusion and Policy Recommendations	45
5.1 Conclusion.....	45
5.2 Policy Recommendations	47
References	48
Appendices	56
Appendix A: Electricity Demand Tables.....	56
A1: BAU and REN Electricity Demand	56
A2: EC Electricity Demand	57
Appendix B: Electricity Supply Tables	58
Appendix B1: BAU Electricity Supply	58
B2: REN Electricity Supply.....	58
B3: EC Electricity Supply.....	59

List of Figures

Figure 1: Installed Power Capacity (MW) by type (%)	1
Figure 2: Energy production in Nigeria (EIA, 2016).....	6
Figure 3: Niger Delta States and Oil Fields	8
Figure 4: Coal and Lignite Occurrences in Nigeria	9
Figure 5: Solar Energy Distribution in Nigeria (Ohunakin et al., 2014).....	10
Figure 6: Nigeria’s Wind Distribution (Nat Met Department)	11
Figure 7: Hydro power plants in Nigeria (Federal Ministry of Power’s website)	12
Figure 8: Primary Energy Supply in Nigeria (IEA, 2016).....	12
Figure 9: Nigeria’s Total Energy Supply (IEA, 2013).....	13
Figure 10: Energy Consumption by sector in Nigeria (EIA, 2010)	13
Figure 11: Energy Consumption from 1990-2010 (UN Stats).....	14
Figure 12: Electricity Generation Sites in Nigeria (Nigeria Power Guide Vol. 3)	15
Figure 13: Transmission Line of Nigeria (Nigeria System Operator)	16
Figure 14: Electricity Distribution (Securities & Exchange Commission, Nigeria)..	17
Figure 15: Nigeria’s LEAP Tree Diagram	20
Figure 16: Nigeria’s energy system model diagram for forecasting and transformation	20
Figure 17: Hourly load duration curve (National Control Centre PHCN, Oshogbo) 21	
Figure 18: Peak load shape used in LEAP	22
Figure 19: BAU and REN Electricity Demand Projections for Each Sector.....	31
Figure 20: Energy Conservation Electricity Demand Projection for Each Sector.....	32
Figure 21: Electricity Demand projection for BAU, EC, and REN scenarios	32
Figure 22: EC electricity demand share by 2040	34
Figure 23: BAU Electricity Supply	35
Figure 24: BAU Sankey Diagram 2040	35
Figure 25: BAU Electricity Supply Mix in 2040	36
Figure 26: REN Electricity Supply	37
Figure 27: REN Sankey Diagram for 2040	37
Figure 28: REN Electricity Supply Mix	38
Figure 29: EC Electricity Supply	39
Figure 30: EC Sankey Diagram for 2040.....	39

Figure 31: EC Electricity Supply Mix 40

Figure 32: GHG Emission of BAU, EC, and REN 42

Figure 33: Comparison of the capital costs of the EC and REN scenarios with BAU
..... 43

Figure 34: Comparison of the Fixed O&M costs of the EC and REN scenarios with
BAU 43

Figure 35: Comparison of the Variable O&M costs of the EC and REN scenarios
with BAU 44



List of Tables

Table 1: Demographic and Economic data used in LEAP.....	25
Table 2: Electricity Demand Data.....	26
Table 3: Electricity Generation Data for Existing Power Plants.....	28
Table 4: Electricity Generation Data for Future Power Plants	28
Table 5: Costs of the Electricity Generating Technologies	28
Table 6: Fuel costs	29



Abbreviations

PHCN	Power Holding Company of Nigeria
NNPC	Nigerian National Petroleum Cooperation
FGN	Federal Government of Nigeria
USAID	United States Agency for International Development
WDI	World Development Indicators
GHG	Green House Gases
NCC	National Control Centre
IPCC	Intergovernmental Panel on Climatic Change
IEA	International Energy Agency
kWh	Kilowatt hours
LEAP	Long Range Energy Alternatives Planning
MAED	Model Analysis of Energy Demand
MW	Megawatts
NPV	Net Present Value
BAU	Business as Usual Scenario
EC	Energy Conservation Scenario
REN	Renewable Energy Scenario
TED	Technology Database
CO₂	Carbon Dioxide
CO₂eq	Carbon Dioxide Equivalent

Chapter 1 Introduction

1.1 Statement

Electricity is essential for the economic development of a country. Electricity consumption per capita is used as a measure to determine how developed a nation is, this clearly shows how important electricity is to the development of any nation. New findings in science and technology, made electricity the most preferred form of energy. Electricity can be easily converted into other forms of energy and has greater flexibility compared to other forms of energy.

Nigeria has a GDP of \$486.793 billion dollars and is the 23rd largest economy in the world (World Bank, 2015). According to vision 20:20, Nigeria targets to be among the top 20 largest economies in the world by 2020 but for that to be achieved it will have to eliminate power outages, which has stagnated the development of the industrial and educational sectors. Nigeria's available electrical capacity ranges between 3500MW to 5000MW (USAID, 2017). For a population of 186 million people this available capacity is clearly insufficient. Electricity supply is only from hydro and gas power plants, which have a percentage share of 22.9% and 77.1% respectively as seen in Figure 1.

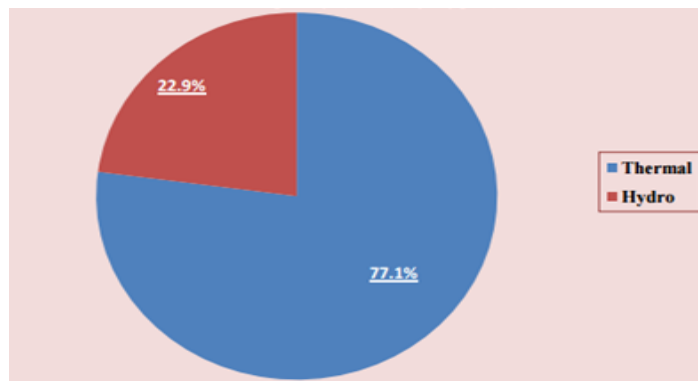


Figure 1: Installed Power Capacity (MW) by type (%)

The Nigerian government has made efforts to improve electricity supply over the years in order to reduce power outages across the nation. Nigeria has allowed the involvement of foreign companies in the power sector to generate their own electricity

(IPP-Independent Power Plants) and sell it to distribution companies. Still the intervention of the private sector has not solved the recurrent power black outs experienced all over the country. This has not only underdeveloped the nation but caused national embarrassment as in the case of the black out at the Murtala Mohammed International Airport in Lagos and the 2009 FIFA under 17-world cup. Increase in population and a rapid economic growth, the government needs to make policies based on forecasts of electricity demand and supply to ensure that power outages are eradicated and there is constant electricity supply in Nigeria. Because of the importance electricity demand and supply forecasts this research work used Long Range Energy Alternatives Planning (LEAP) to project the electricity supply and demand from 2010 to 2040.

1.2 Scope and Outline of the Study

The study focused on projecting the electricity supply and demand using Long Range Energy Alternatives Planning (LEAP). Three scenarios namely Business as Usual (BAU), Energy Conservation (EC), and Renewable Energy (REN) based on the policies of the Federal Government of Nigeria (FGN) were developed to simulate the electricity demand and supply for the target year 2040. Cost and the GHG emission analysis of the scenarios were carried out and the three scenarios were compared to each other to determine the best path the Nigerian government should follow in order to provide uninterrupted power supply.

The summary of the five chapters of the thesis is given below.

Chapter 1 consists of the basic structure of the thesis and a brief detail about previous studies done on electricity forecast using various methods and applications such as LEAP (Long Term Alternative Energy Planning), ARIMA (Autoregressive Integrated Moving Average models) and MAED (Model for Analysis of Energy Demand).

Chapter 2 includes the overview of the energy sector of Nigeria. It provides the basic information concerning primary energy production, consumption of final energy, electricity generation, transmission, and distribution in Nigeria.

Chapter 3 gives an overview of the LEAP energy model. It contains information such as the LEAP algorithm, Nigeria's LEAP tree diagram, the summary of policy documents that were used in formulating the scenarios such as National Renewable Energy and Energy Efficiency Policy (NREEEP), the Renewable Energy Master Plan (REMP) and the Sustainable Energy for All Action Agenda (SE4ALL-AA) adopted by (Inter Ministerial Committee on Renewable Energy and Energy Efficiency-ICREEE). The chapter also contains the design of the BAU (Business as Usual), EC (Energy Conservation) and REN (Renewable Energy Scenarios), energy demand data used, energy supply data, fuel costs, transformation data and the emission data used in LEAP.

Chapter 4 contains the results and discussions of the electricity demand and supply, GHG emission analysis and cost analysis of the three generated scenarios; BAU, EC, and REN which were obtained from LEAP.

Chapter 5 contains the conclusion and policy recommendation of the study carried out.

1.3 Literature Review

There is extensive literature available on electricity demand and supply forecasts for Nigeria. The present challenge in the electricity sector has led to many researchers carrying out studies on how to solve the never-ending problem in the electricity sector and find alternatives in order to reduce carbon emissions. Most of the studies compare different scenarios and discuss the results obtained. A couple of the research work that were carried out on the Nigerian electricity sector are being listed below.

Sambo (2008) did energy demand projections using MAED (Model for Analysis of Energy Demand). Demography, socio-economy and technology were used as key drivers for the four scenarios namely the Reference Scenario (7% GDP Growth), High Growth Scenario (10% GDP Growth), Optimistic Scenario I (11.5% GDP Growth) and Optimistic Scenario II (13% GDP). The study found out that 484.62 billion USD of investments is required in order to meet the demand for the Optimistic Growth Scenario.

Adams et al. (2011) used univariate time series model (ARIMA) to determine ten years electricity generation forecast using data between 1970 and 2009. The ARIMA model revealed that electricity generation in Nigeria would reduce further.

Pelesai and Apere (2013) did a study using annual times series data. The report suggested that demand of electricity in Nigeria is elastic and electricity companies cannot increase their revenue by increasing price.

Amlabu et al. (2013) used least squares technique to determine the electrical load demand forecast in four different regional power supplies scenarios in Nigeria. The overall result showed a continuous growth in load demand in the selected regions.

Ezennaya et al. (2014) focused on Nigeria's electricity demand forecast from 2013-2030 using Time Series Analysis method. Electricity supply in Nigeria was found insufficient. The report recommended that about 20,000 MW of electricity has to be generated or imported.

Oyelami and Adewumi (2014) used Harvey logistic model to calculate the demand and supply of electricity in Nigeria from 2005 to 2026. It estimated that about 317.5 billion US dollars business opportunities are open for new independent power stations in Nigeria.

Emodi et al. (2015) modelled Nigeria's energy demand and supply under four scenarios which are the reference (REF), the low carbon moderate (LCM), the low carbon advanced (LCA), and the green optimistic (GO) using Long Range Energy Alternative Planning (LEAP). They REF scenario energy demand will reach 3,075 PJ with a GHG emissions of 201.2 Million tons CO_{2e} by 2040. The aggressive policy used in the GO scenario, would significantly reduce the energy demand to 2,249 PJ and GHG emissions 124.4 Million tons CO_{2e} in 2040.

Adebayo (2016) used Autoregressive Integrated Moving Average (ARIMA) model to forecast electricity utilization in Nigeria, as a way to examine the situation under which the country could attain the target of being among the top 20 economies by 2020. The

research work found out that if the current trend of electricity consumption in Nigeria continues, Nigeria would only achieve the target of being among the top 20 economies by the year 2671.

1.4 Materials and Methods

LEAP (Long Range Energy Alternatives Planning) is an energy modelling tool used to project energy consumption, supply, GHG emissions, cost analysis in all sectors of an economy. It is being used in both the energy sector and non-energy sector. LEAP in this study was used to match electricity demand with supply in Nigeria and data from agencies and organisations such as the World Bank (World Bank Development Indicators), National Population Commission, National Bureau of Statistics, International Energy Agency, Central Bank of Nigeria Statistical Bulletin, National Renewable Energy, and Efficiency Policy Report (NREEEP, 2015), The Renewable Energy Master Plan (REMP, 2013) and Sustainable Policy for All Action Agenda (SE4LL-AA, 2016). The data includes information about renewable energy and energy efficiency targets, projected population growth, GDP, government electricity demand and supply projection and emission factors.

The major source of information is from government agency websites, and studies completed by various researchers residing within Nigeria and abroad.

Chapter 2

Overview of the Energy Sector and Electricity Infrastructure in Nigeria

2.1 Primary Energy Supply and Consumption Situation in Nigeria

Nigeria is among the biggest players in the oil and gas industry in Africa. It has the second largest natural gas reserves behind Algeria with a proven oil reserve estimated to be at 36.2 billion barrels and a gas reserve of 166 trillion SCF (ECN, 2007). Nigeria's oil and gas reserves are located in the south-south and south-eastern parts of the country. Studies have also been carried out in the in the Chad basin, which is in the north-eastern part of the country to determine the possibility of oil exploration in that region. The hydroelectricity potential of Nigeria is in excess of 11,000 MW (Ismaila, 2006). Biomass is abundantly available in Nigeria and is the most used energy resource especially in the rural areas.

Crude oil has been the most explored energy source in Nigeria since the 1970's. However, natural gas production grows at the highest pace compared to other primary energy sources. Figure 2 shows the energy production in Nigeria which is released by the US Energy Information Administration (EIA). It highlighted Nigeria's heavy reliance on fossil fuels for meeting the Nigerian energy requirements (EIA, 2016). There is a clear reliance on fossil fuels in for secondary energy provision. Sectors such as transportation, electricity generation, and residential use, contribute to the growth and heavy reliance on crude oil.

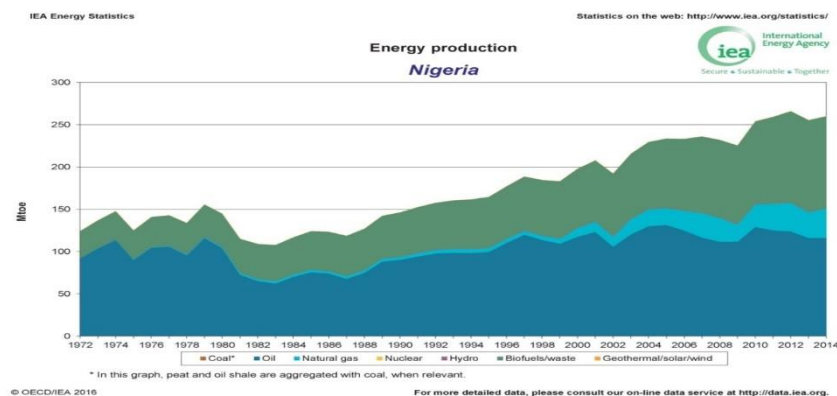


Figure 2: Energy production in Nigeria (EIA, 2016)

2.1.2 Energy Resources and Reserves

Nigeria has vast energy resources ranging from fossil fuels (oil, natural gas, coal), to renewables (hydro, solar, wind, biomass). Each energy resource is explained in detail below:

2.1.2.1. Oil

Nigeria has the second largest oil reserves in Africa after Libya, estimated at about 37 billion barrels (CIA, 2016). The oil reserves as shown in Figure 3 are located in the south-south states such as Akwa Ibom, Rivers, Bayelsa, Cross River, Ondo, Edo, and in Abia and Imo in the south-east.

Nigeria's average oil production was at an average of 2.28 million barrels as of 2015 (EIA, 2015), but by May of 2016 attacks on the oil infrastructure led to a massive decrease in production, as crude oil production fell below 1 million barrels (CNN, 2016). Foreign oil companies are those usually involved in the oil exploration in Nigeria based on a production-sharing contract agreement with the Nigerian National Petroleum Corporation (NNPC).

Nigeria has four oil refineries in which two are located in Port Harcourt, one in Warri, and the other one in Kaduna, which have a total installed capacity of 445,000 barrels per day (NNPC, 2016). None of these refineries has been functional to its optimum capacity over the years due to poor maintenance, theft and fire. Due to technical issues with the refineries, the NNPC spends millions of dollars daily to import petroleum products.



Figure 3: Niger Delta States and Oil Fields

2.1.2.2. Coal

Coal was discovered in the eastern part of Nigeria, and exploration commenced in the 1910's. Presently, Nigeria's proven coal reserves are at about 1.5 billion metric tons to 2.75 billion metric tons (Akubo et al., 2013). The location of the existing coalmines in Nigeria are shown in Figure 4 below; mines in the state of Enugu, Kogi, and the Owukpa mine in Benue state. The Nigerian Coal Corporation (NCC) in charge of the exploration and development of the coal resources was developed in 1950. Coal production peaked to 905,000 tons between 1958-1959, which attributed to more than 70 percent of Nigeria's energy consumption. Rise in the coal production led to the development of several companies such as the Nigerian railways, Electricity Corporation of Nigeria, and the Nigeria Cement Company which were fully functional up until the late 1960s.

However, during Nigerian Civil War (1966–1970), all the coalmines were abandoned and there was no coal production. As of 2001, coal's share of Nigeria's total energy consumption was close to zero (Oramah, 2006).

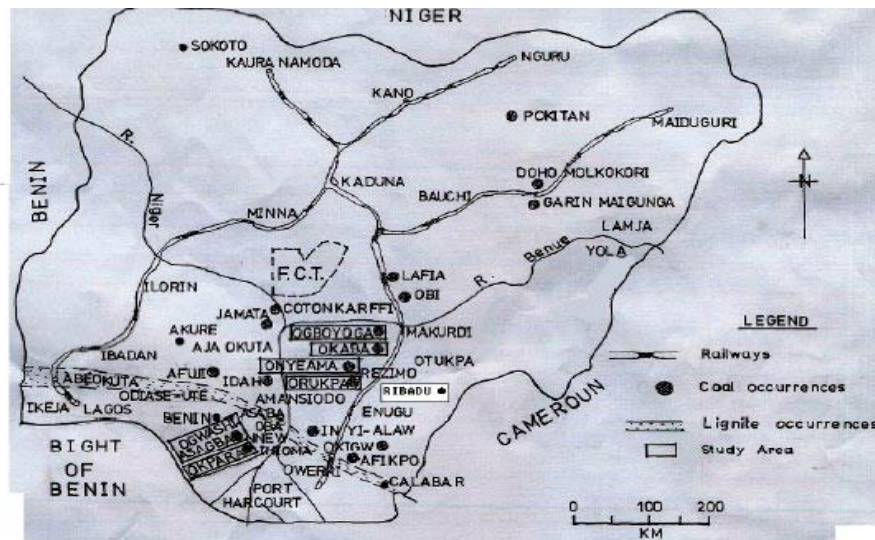


Figure 4: Coal and Lignite Occurrences in Nigeria

2.1.2.3. Natural Gas

Nigeria has an estimated proven natural gas reserve of 159 trillion cubic feet (TCF), which ranks Nigeria among the top ten countries with the largest gas reserves in the world. Because of inadequate infrastructure in the gas sector, Nigeria flares about 40% of the natural gas it has produced, and re-injects another 12% to enable oil recovery (NNPC, 2016). Natural gas is the most used energy source for electricity generation in Nigeria. The thermal power plants for electricity generation in Nigeria completely run on natural gas, which makes natural gas a very important energy source.

2.1.2.4. Uranium

Uranium deposits mainly come from sandstones, quartz-pebble conglomerates, calcicrete, shales and phosphates. The sandstone is the richest and is available in Nigeria (Obaje, 2013). The sandstone is mainly found in areas of Sokoto, Benue and other middle Niger basins parts. Uranium deposits in Nigeria are also found in other parts of the country such as Kano, Kaduna, Adamawa and Gombe states (Adekanmi et al., 2007).

2.1.2.5. Biomass/Biofuels

Biomass is a renewable energy source that is obtained from various sources such as agricultural crops and their residues, forestry resources, municipal and animal waste.

Nigeria has abundance of biomass resources estimated to be at about 80 million cubic meters (43.4×10^9 kg), majorly used for cooking in Nigeria (Enibe and Odukwe, 1990). Because of Nigeria's vast land mass it has the capacity to be a major biomass supplier to the world. Nigeria has large quantities of animal and poultry waste, estimated at 227,500 tons which when converted into energy (Biogas) will amount to 2.2×10^9 MJ, this can then be used for cooking and electricity generation (Oyedepo, 2014).

2.1.2.6. Renewable Energy

Renewable energy is the energy source that replenishes itself such as hydro, solar, biomass, wind, tidal, and geothermal. Solar radiation is the largest renewable energy resource on earth, and it is estimated that countries which are between latitudes 35°N and 35°S receive at least 200 hours of uninterrupted direct radiation per year which is sufficient for the utilization of solar energy (Abdulrahim, 2010). Nigeria fortunately lies between latitudes 4°N and 14°N of the equator which is ideal for harnessing the energy from the sun. Nigeria receives an average solar radiation of about 7.0 kWh/m^2 daily in the north, and about 3.5 kWh/m^2 daily in the southern part as shown in Figure 5 (Ileoje, 1997).

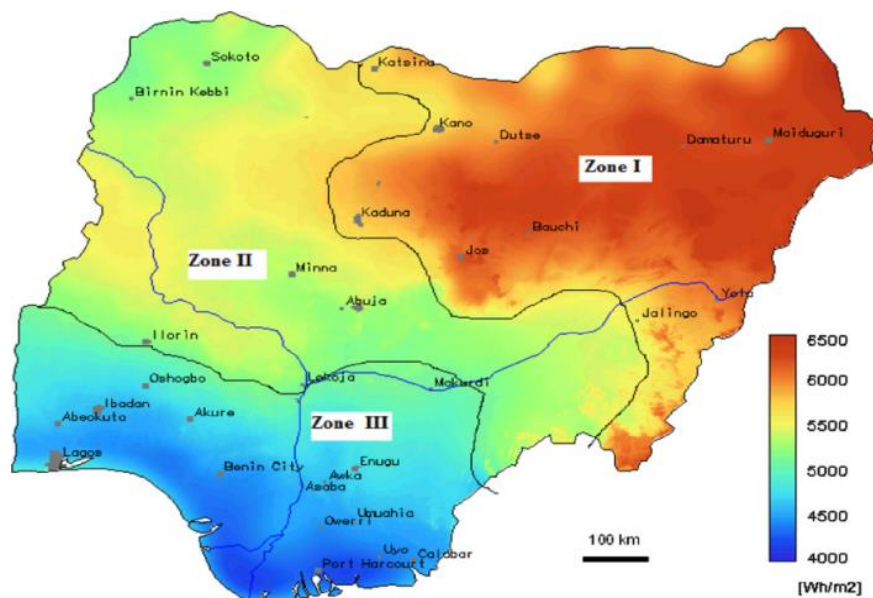


Figure 5: Solar Energy Distribution in Nigeria (Ohunakin et al., 2014)

Nigeria has abundance of wind energy potential over most parts of the country. Figure 6 shows the wind distribution in Nigeria (Ajayi, 2010). Wind speeds attain average speeds of 2.0 m/s in coastal regions and 4.0 m/s in the northern part of the country. This clearly shows that wind speeds in the southern parts of the country are pretty low, however it can be harnessed for electricity generation using smaller wind turbines. Employing this strategy will be a major breakthrough for places which don't have access to electricity. Based on the wind energy mapping developed by the Federal Ministry of Science and Technology, the highest wind speeds are in the Sokoto region, Gembu, Kano and the Jos Plateau. There's also fair wind speeds in Maiduguri, Lagos and Enugu, sufficient for energy generation by wind farms. Other parts with high wind energy potential Lagos Region and the Mambila Plateau. Wind energy has been utilized for various applications other than electricity generation such as grain grinding and water pumping since the 1960's (Chel and Kaushik, 2011).

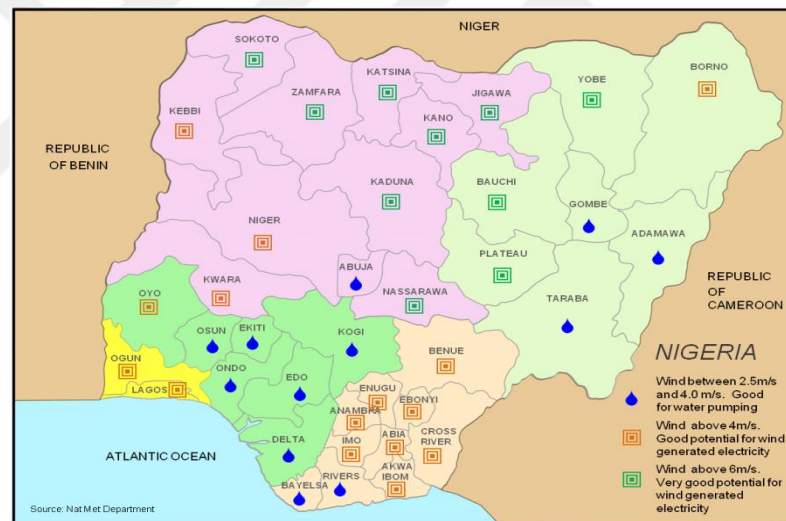


Figure 6: Nigeria's Wind Distribution (Nat Met Department)

Nigeria's ministry of power classifies hydropower plants into large and small hydro power plants. Hydro power plants that generate less than 30 MW are generally classified as small hydro power plants. On other hand, hydro power plants that generate more than 30 MW/100 MW are classified as large hydropower plants Hydro power plants (FMP, 2015). Hydro power plants account for about 32 % of Nigeria's electricity generation (Sambo, 2005). The majority of hydropower plants in Nigeria

are located in the states of Taraba, Niger, Benue, Kogi, Anambra as shown in Figure 7 below:

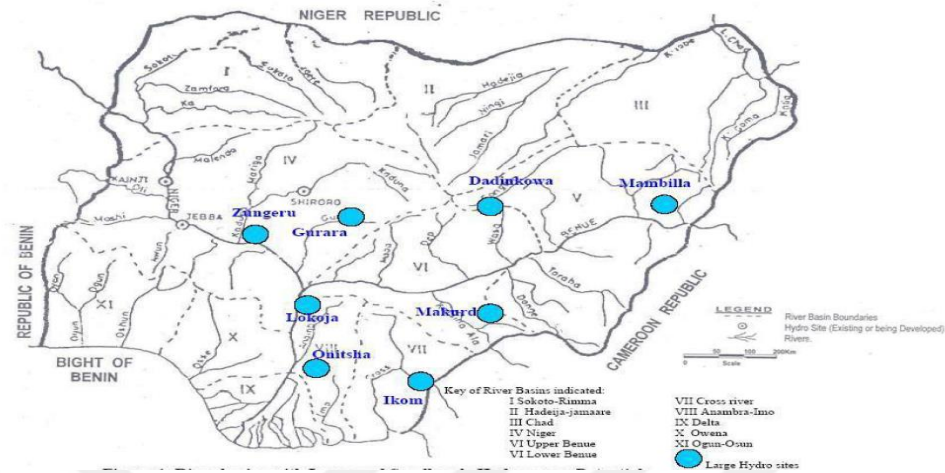


Figure 7: Hydro power plants in Nigeria (Federal Ministry of Power's website)

2.1.3 Primary Energy Supplies

Figure 8 shows that from 1972-2014 there is more dependence on biofuels/waste which has risen to a level of 120-140 Mtoe, while oil and natural gas has been constant, in spite of more exploration in the oil and natural gas sector (IEA, 2016). Seemingly, inadequate infrastructure for refining oil and transportation facilities for the natural gas are the major factors. This makes biomass the most attractive energy source in Nigeria followed by natural gas, oil, and then hydro as illustrated in Figure 9 (IEA, 2016).

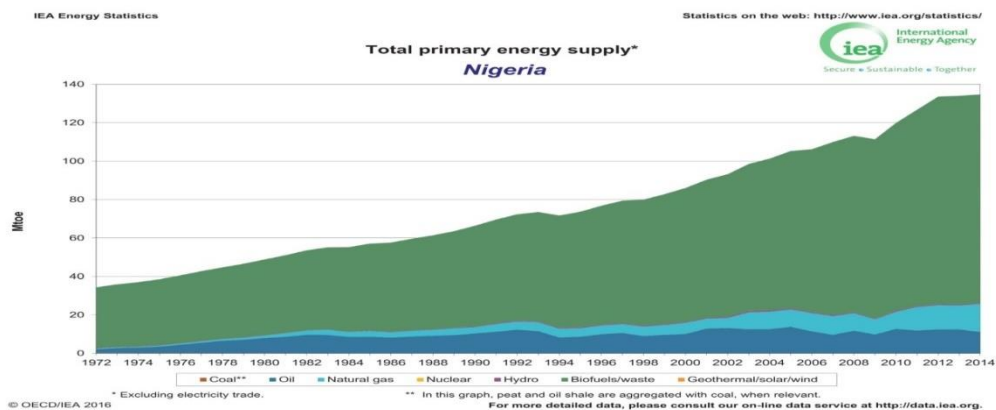


Figure 8: Primary Energy Supply in Nigeria (IEA, 2016)

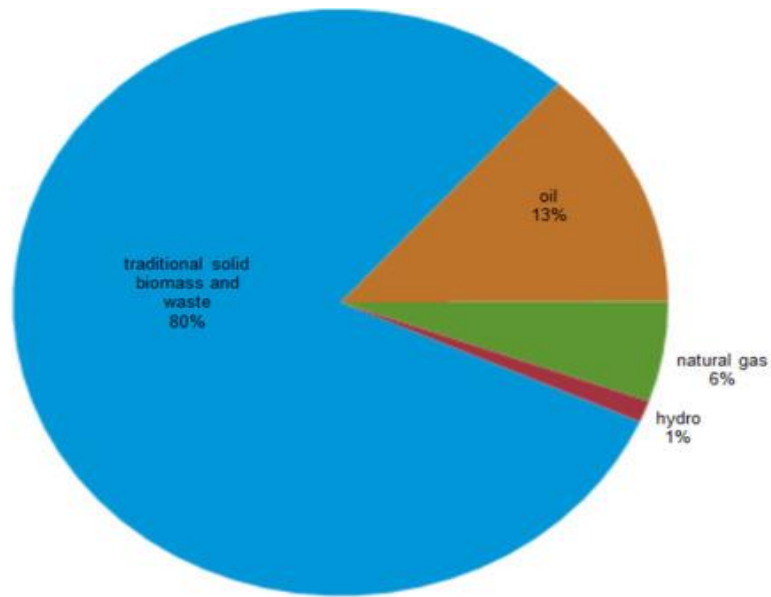


Figure 9: Nigeria's Total Energy Supply (IEA, 2013)

2.1.4 Final Energy Consumption

Nigeria's energy consumption is estimated at 116,457 ktoe, the residential sector accounts for the majority of the energy consumed. Figure 10 below shows the electricity consumption for the different sectors. Figure 11 shows the share of electricity consumption between household, industry and the other sectors from 1990 to 2010, in which that household has the highest share.

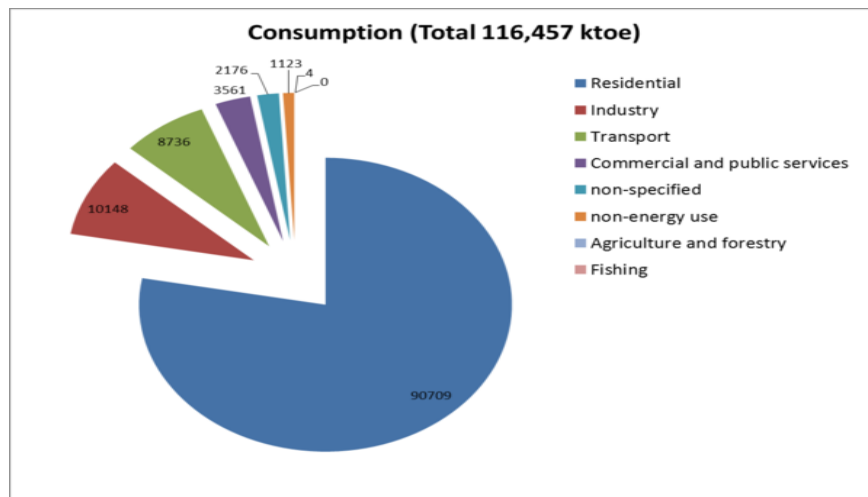


Figure 10: Energy Consumption by sector in Nigeria (EIA, 2010)

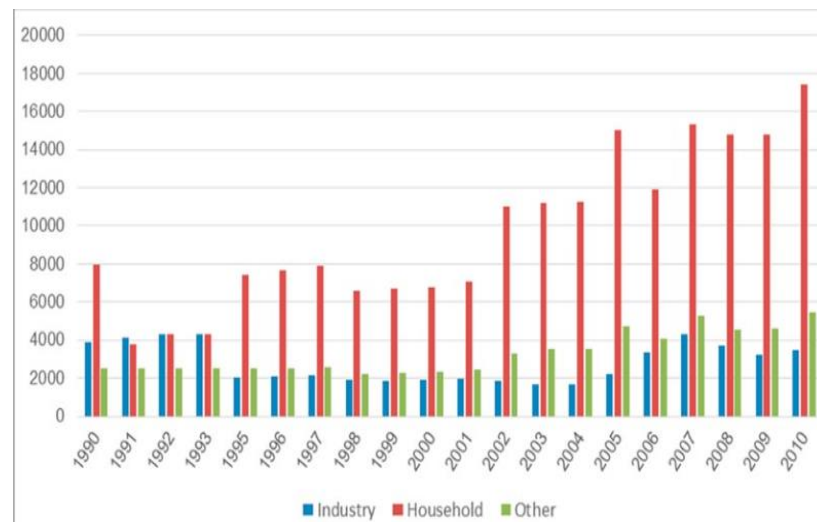


Figure 11: Energy Consumption from 1990-2010 (UN Stats)

2.2 Overview of the Nigerian Electricity Sector

The first power plant in Nigeria was located in Lagos state in 1898, which had a total capacity of 60 kilowatts (M. Dada, 2016). Then in 1950, a central body was established to take up the responsibility of the electricity supply outlets in Nigeria. The central body was referred to as Electricity Corporation of Nigeria (ECN). In 1962, Niger Dams Authority (NDA) was established and was in charge of dam construction which led to projects such as the Kainji Dam in 1968. In 1972, ECN and NDA were merged to form National Electric Power Authority (NEPA). From 1999-2005 PHCN was formed by the government to revive the power sector, with the introduction of the National Integrated Power Projects (NIPP) in 2004 to enable the quick upgrading of the electrical infrastructure in Nigeria. The PHCN was subsequently unbundled into 18 companies, which consist of six generating companies, one transmission company and eleven (11) distribution companies (Awosope, 2014).

2.2.1 Electricity Generation in Nigeria

The Nigerian Electricity Supply Industry (NESI) was formed due to the disaggregation of the power sector, which has 23 grid-connected power plants with a total installed capacity of 10,396 MWMW and an available capacity of 6056 MW (Vincent and Yusuf, 2014). The three major Hydropower plants have an installed capacity of 1938

MW and an available capacity of with 1060 MW, with Figure 12 showing the various electricity generation sites in Nigeria.

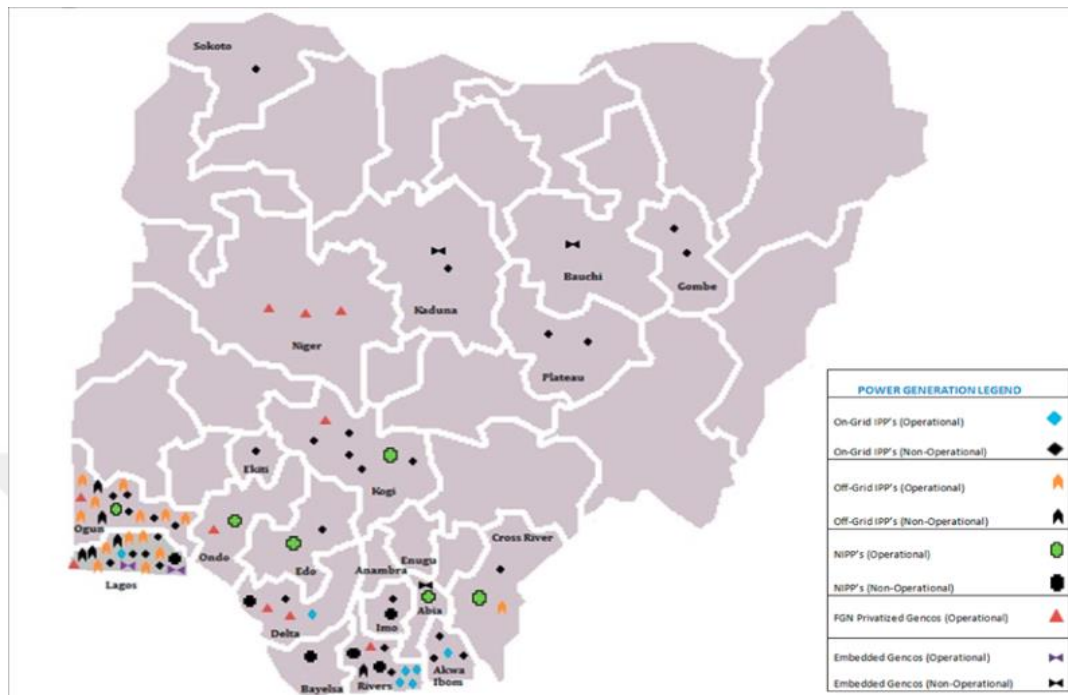


Figure 12: Electricity Generation Sites in Nigeria (Nigeria Power Guide Vol. 3)

The power plants are mostly gas powered due to Government's focus on thermal plants because of their high efficiencies. Nigeria set targets to increase the generation capacities of the gas power plants and hydropower and also aims to include other electricity generation sources such as nuclear and coal to its generation mix, which will reduce its dependence on natural gas.

2.2.2 Electricity Transmission in Nigeria

The Transmission Company of Nigeria (TCN) is the only part of the power value chain which is completely owned by the Federal Republic of Nigeria and emerged from the unbundling of the National Electric Power Authority (NEPA) in 2005. Transmission Company of Nigeria manages the operation, maintenance, and the expansion of the 132kV and 330kV transmission system. The transmission network shown in Figure 13 is made up of 159 substations and 15,022km of transmission lines with a capacity of 5300MW but far less than the total installed capacity of 12,522MW (Nigerian Power Report). Transmission losses are high compared to the benchmark of 2-6% set by

developing countries, the losses are because of the challenges faced by the infrastructure and operation. The ineffective management of the infrastructure and operations of the transmission lines have led power shortages across the country.

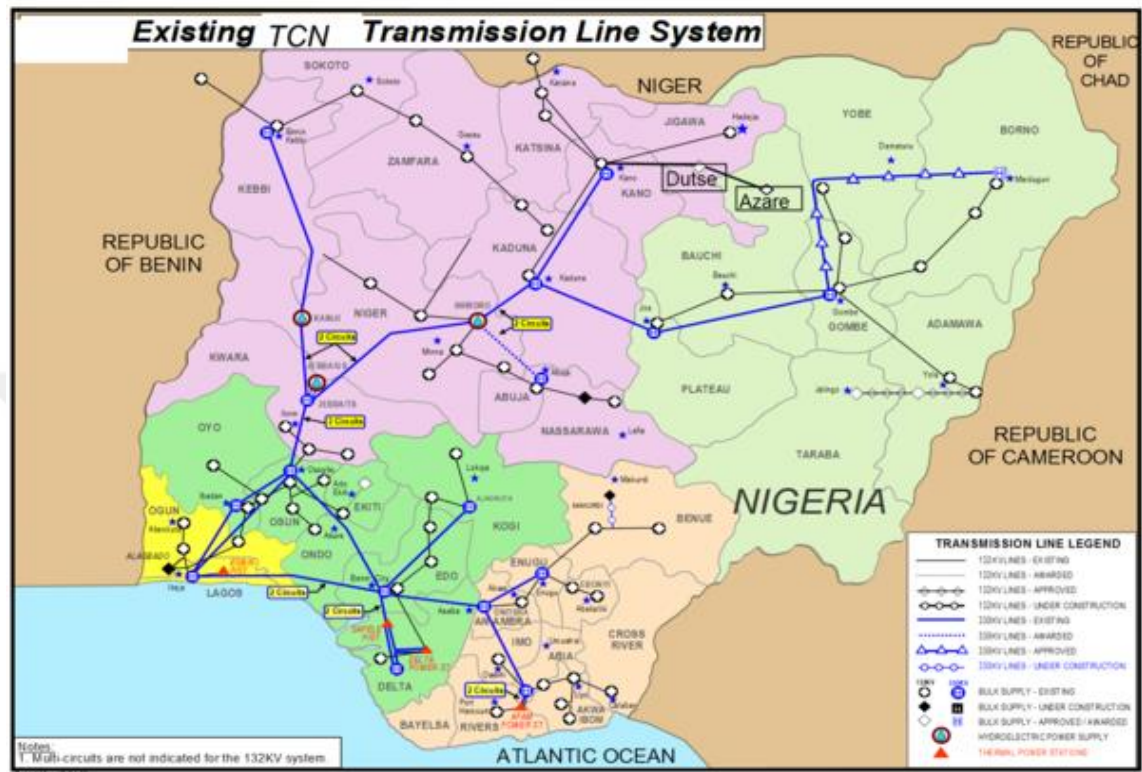


Figure 13: Transmission Line of Nigeria (Nigeria System Operator)

2.2.3 Electricity Distribution in Nigeria

The grid line operates medium and low voltages (33kV and 11kV, respectively), there were more than 24000 km distribution network in 2010 (NERC, 2011). Figure 14 shows the distribution companies and the amount of electricity allocated to them. There are 11 electricity distribution companies (DISCOS) which are in charge of the distribution of electricity in Nigeria. Ikeja Electricity Distribution Company is the largest which covers 36,585 km, Kano on the other hand is the shortest which covers 7,404 km and has the highest losses of 40%. Ibadan network has the highest capacity of 878 MW with 812,000 customers, while the Ikeja network has the highest peak demand of 1,400 MW due to the high demand of electricity by companies in that particular location (Shonibare, 2014).

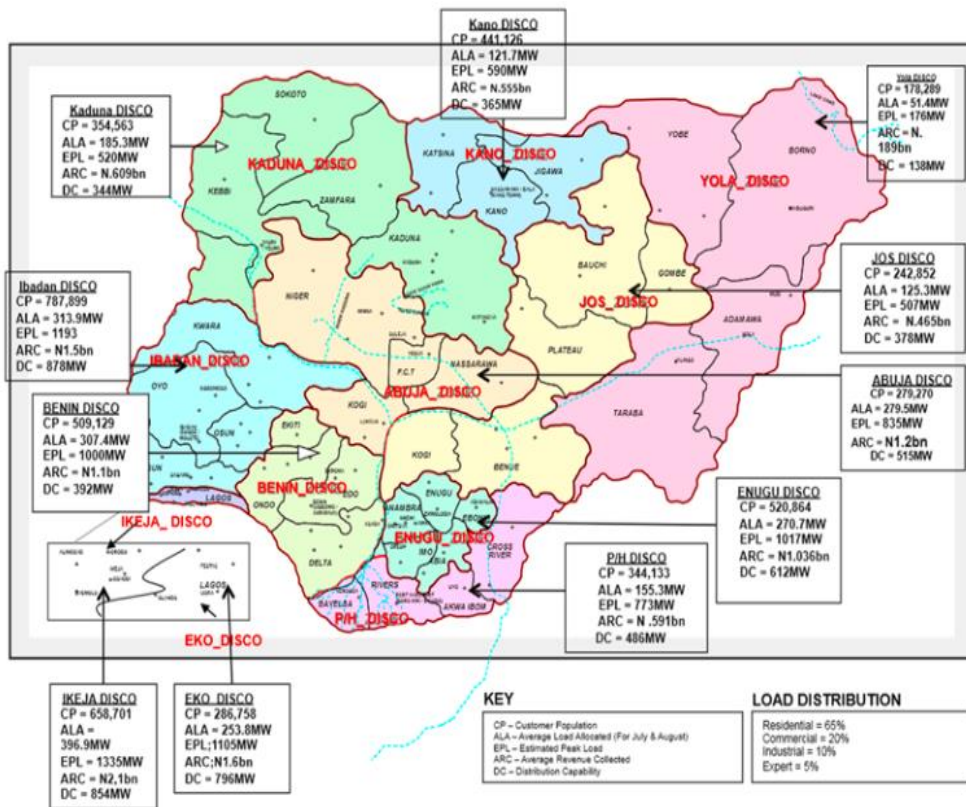


Figure 14: Electricity Distribution (Securities & Exchange Commission, Nigeria)

Chapter 3

Methodology

This chapter consists of the methodology used for the electricity supply and demand, GHG emissions and cost analysis projections for Nigeria from 2010 to 2040. A base year of 2010 was chosen for this study based on the availability of data.

3.1 The LEAP Model

The Long Range Energy Alternatives Planning (LEAP) energy model was developed by the Stockholm Environment Institute to analyse energy policies and to assess GHG emissions (Heaps, 2012). A major advantage of LEAP is its low data requirements and is based on physical energy and ecological policies. LEAP has been used by individual researchers and organisations to project future energy supplies, consumptions and GHG emissions to enable them formulate energy policies.

3.2 LEAP Algorithm

The framework used by LEAP for the calculation of energy consumption and carbon emissions as according to (Feng and Zang, 2012) is presented as follows:

3.2.1 Energy Consumption

The total final energy consumed is calculated using the following equation:

$$EC_n = \sum_i \sum_j AL_{n,j,i} \times EI_{n,j,i}$$

EC is the aggregate energy for a given sector, AL represents activity level, EI is the energy intensity, n is fuel type, i is sector, and j is the device.

Transformation of net energy consumption is calculated using the following equation:

$$ET_s = \sum_m \sum_t ETP_{t,m} \times \left(\frac{1}{f_{t,m,s}} - 1 \right)$$

ET is the transformation net energy consumption, ETP being the net energy transformation product, f is the energy transformation efficiency, s is the type of primary energy, m is equipment, and t the type of secondary energy.

3.2.2 Carbon Emission

Carbon emission of the final energy is calculated using the following equation:

$$CEC = \sum_i \sum_j \sum_n AL_{n,j,i} \times EI_{n,j,i} \times EF_{n,j,i}$$

Whereby CEC stands for carbon emission, AL is activity level, EI is energy intensity, $EF_{n,j,i}$ is carbon emission factor, n is for equipment j from sector i

Then the carbon emission of energy transformation is obtained using the following equation:

$$CET = \sum_s \sum_m \sum_t ETP \times \frac{1}{f_{t,m,s}} \times EF_{t,m,s}$$

CET is the carbon emission, ETP energy transformation project, f is energy transformation efficiency, $EF_{t,m,s}$ is emission factor from primary fuel type s for producing fuel type j through equipment m .

3.2.3 Costs

Costs are calculated using the following equation (Webmeets, 2015):

$$C = \sum_i \sum_j \left\{ \left[\sum_n (e_{n,j,k} \times ep_n) + \sum_k (m_{k,j,i} \times mp_k + fc_{j,i}) \right] p_{i,j} \right\}$$

C is the total cost, ep_n is unit price of fuel type n , $m_{k,j,i}$ is demand for material k per unit of production used in equipment j within production process I , mp_k unit of material k and $fc_{j,i}$ fixed cost per unit production through equipment j .

3.3 Nigeria's LEAP Tree Diagram

The Nigerian LEAP tree diagram is made up of two branches namely the demand and supply branch as shown in Figure 15. The demand branch is made up of the household sector which is divided into urban and rural, with final energy end users such as electricity, refrigeration, air conditioning, electronics, food preservation, and water heating. The demand branch also includes the commercial and industrial sector (Emodi et al., 2016). The supply branch is made up of existing power generation plants such as hydro and nuclear, with future additions like nuclear, small hydro, biomass, wind, and small hydro.

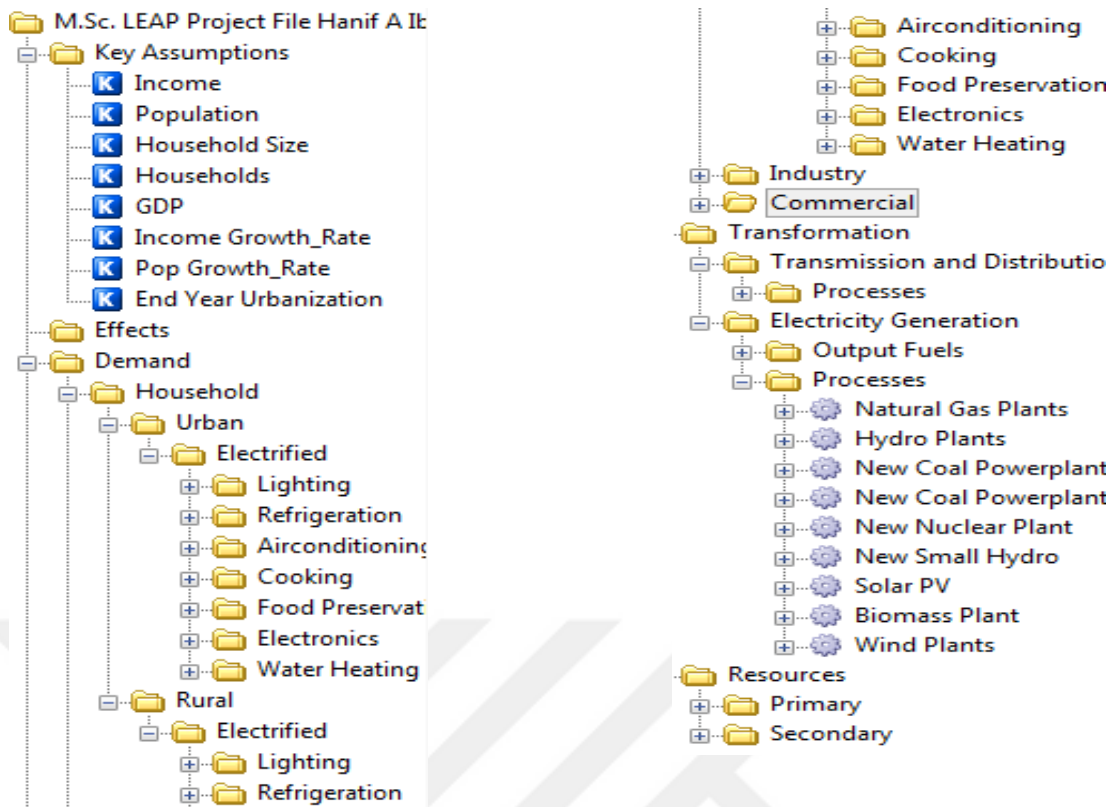


Figure 15: Nigeria's LEAP Tree Diagram

The model diagram used for forecasting Nigeria's electricity consumption, supply, predicting GHG emission, and cost analysis is shown in Figure 16.

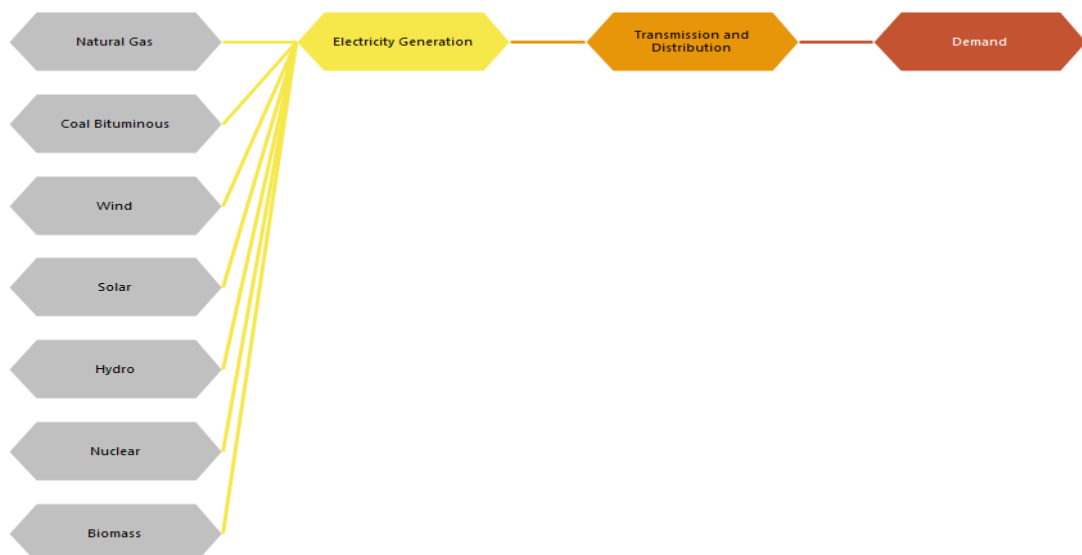


Figure 16: Nigeria's energy system model diagram for forecasting and transformation

3.4 Load Duration Curve

A very important factor considered for the simulation of the electricity supply is the Load Duration Curve (LDC). Demand for electricity is not constant, for instance in the morning there would be higher electricity demand when compared to the afternoon when everybody is at work and school, during the hot season (summer) in Nigeria electricity demand would significantly increase because of more usage of air conditioners and refrigerators because of excessive heat. This clearly shows how demand clearly varies on a day-to-day basis. This made LDC very important on how to determine the operating schedule of the power plants to choose between the base and peak load power plants. The LDCs are produced by Transmission Company of Nigeria, which uses hourly electricity generation data as shown in Figure 17. The time slices were divided into nine. Then, the percentages of the electricity consumption of the time slices used in LEAP as shown in Figure 18. were obtained by taking the percentage of the ratio of the electricity consumption of the second time slice to the ratio of the maximum electricity consumption in which 93.8 was obtained for the first time slice. The same procedure was carried out for the remaining time slices.

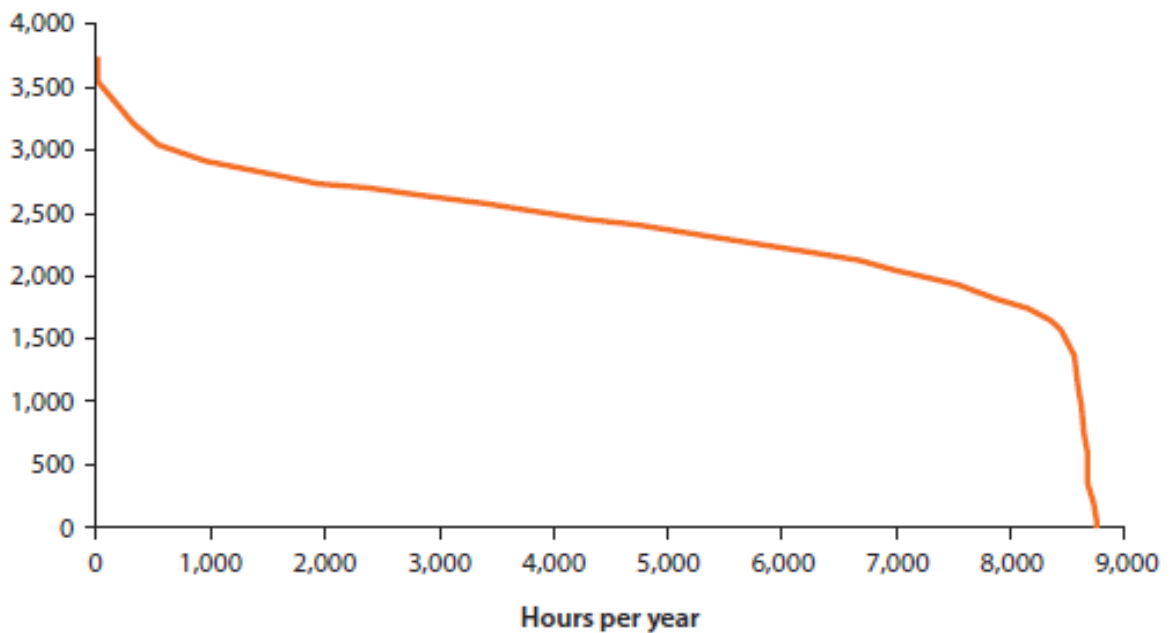


Figure 17: Hourly load duration curve (National Control Centre PHCN, Oshogbo)

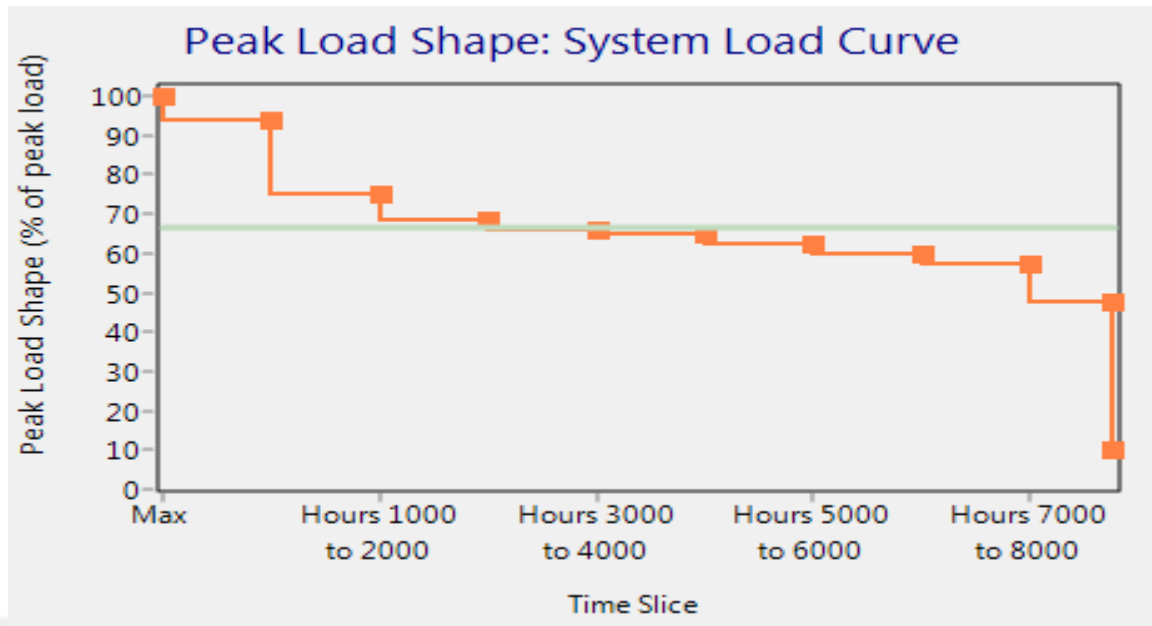


Figure 18: Peak load shape used in LEAP

3.5 Data collection and Scenario Design

The three scenarios developed in this study were based on the Federal Government of Nigeria's initiative on energy conservation and renewable energy. Documents such as the National Renewable Energy and Energy Efficiency Policy (NREEP), Sustainable for All Action Agenda (SE4ALL-AA) and the Nigerian Renewable Energy Master Plan (REMP) were all used to formulate the three scenarios namely; BAU (Business-as-usual), EC (energy conservation), and REN (renewable energy). A brief information about these energy policy documents are given in the following sections.

3.5.1 National Renewable Energy and Energy Efficiency Policy (NREEP, 2015)

The main reason behind the NREEP report (2015) was to optimize the utilization of the national natural resources in order to achieve a sustainable level of growth. The report was approved by Nigeria's Federal Executive Council (FEC) in 2015 to ensure the following issues:

- i. To develop a framework that will address Nigeria's challenge in accessing renewable energy that will lead to improved energy security and meet the climate objectives.

- ii. To increase Nigeria's level of electricity generated from renewables to meet or even exceed the target set by ECOWAS (Economic Community of West African State).
- iii. To enlighten the public about energy efficiency that if embraced will lead to savings on energy bills and provide employment.
- iv. To set national targets in energy efficiency and renewable energy.
- v. To facilitate a framework for financing renewable and energy efficiency projects in Nigeria.
- vi. To set a time frame in which these projects in renewable and energy efficiency projects will be completed.
- vii. To make it mandatory for the Ministry of Energy to supervise the ongoing projects.

3.5.1.1 Renewable Energy Targets Set by (NREEP, 2015)

The following are targets set by (NREEP, 2015) for power generation from biomass, solar, small hydro, and wind:

- The capacity of small hydro power plants to attain 8173.81 MW by 2030
- The capacity of biomass power plants to attain 3211.4 MW by 2030
- The capacity of wind power plants to attain 291.92 MW by 2030.

3.5.2 The Renewable Energy Master Plan (REMP, 2013)

The Renewable Energy Master Plan (REMP, 2013) a document developed by Nigeria's Federal Ministry of Environment targets to increase the supply of electricity from renewable energy sources with solar PV to attain 500 MW 2025. The REMP is set also setup to provide incentives to support renewable energy. The plan will reduce duties on renewable energy technologies being imported. It will also provide tax credits, capital incentives and loans for new renewable energy projects.

3.5.3 Sustainable Energy for All Action Agenda (SE4ALL-AA, 2016) Adopted by (Inter-Ministerial Committee on Renewable Energy and Energy Efficiency ICREEE)

The (SE4ALL-AA, 2016) initiative has set objectives in providing safe, renewable and affordable energy for both renewable and non-renewable energy sources. It has three goals which are Energy Access, Energy Efficiency, and Renewable Energy that have the following objectives being listed below:

Energy Access Targets:

- Increase energy access in urban areas to 90 percent by 2030
- Increase energy access in rural areas to 60 percent by 2030

Energy Efficiency Targets:

- Efficient lighting will be used by 40 percent of the household by 2020 and almost 100 percent by 2030.
- High energy consuming devices efficiency will be atleast to 20 percent by 2020 and 50 percent by 2030.

Renewable Energy Targets:

- To achieve atleast 30 percent of renewables in the electricity generation mix by 2030.
- Inclusion of renewable energy technologies such solar, wind, biomass and a 1200 MW of nuclear by 2025 into the energy mix.

3.6 Data Used in LEAP

3.6.1 Demographic and Economic Data

The demographic and economic data includes GDP, population, population growth rate, income, income growth rate, and urbanisation. The data was obtained from sources such as World Development Indicators (WDI), International Energy Agency (IEA), Central Bank of Nigeria (CBN), and the National Bureau of Statistics of

Nigeria. Table 1 shows the demographic and economic data used in LEAP for the base year 2010.

Table 1: Demographic and Economic data used in LEAP

Type of Data Used	Value of Data in 2010
Income	1,460 thousand USD
Population	159.4 million people
Household Size	5 people
Households	32 million households
GDP	367.128 billion USD
Income Growth Rate	8.6%
Population Growth	2.55%
Urbanisation	44%

3.6.2 Energy Demand Data Used in LEAP

Final energy intensities of various electrical appliances in the demand branch of LEAP were obtained from (Emodi, 2016) and that for the efficient end users were obtained from (Almeida et al., 2011) are shown in Table 2. Final energy intensities for the commercial and industrial sectors were obtained using the ratio of the annual energy consumed of each sector to its value added (Heap, 2015). The value added by the commercial and industrial sectors are 196.44 billion USD and 80 billion USD respectively (WDI, 2010). On the other hand, electricity consumed by commercial and industrial sectors are 469 thousand KTOE and 279 thousand KTOE respectively (IEA, 2015).

Table 2: Electricity Demand Data

Electric Appliance	Final Energy Intensity	Efficient Final Energy Intensity	Owned by households (%)
Lighting	506.28 kWh	182 kWh	100
Refrigeration	402.01 kWh	180 kWh	87
Air-conditioning	191.04 kWh	40 kWh	47
Cooking	46.44 kWh	15 kWh	-
Food Preservation	47.64 kWh	32 kWh	42
Electronics	395.04 kWh	260 kWh	90
Water Heating	0.6 kWh	0.6 kWh	70

3.6.3 Emission Data Used in LEAP

LEAP has a Technological Environmental Database (TED), which has data from Assessments Reports of Intergovernmental Panel on Climate Change (IPCC), International Energy Agency (IEA), US Department of Energy (DOE) and from dozens of other institutions. Tier 1 defaults from AR2 factors from 1996 were used in carrying out this study because they still remain the industry standard.

For the study carried out, only the GHG emissions in the electricity generation process were considered. This is due to the fact that the LEAP energy modelling tool does not consider GHG emissions at the cultivation, fabrication, construction and decommissioning stages of the energy supply and consumption process. Even the renewable energy technologies which are considered carbon free emit GHG at various stages of their life cycle. For instance, during the production of renewable energy technologies GHG's are being released to the atmosphere and the amount of emissions differs by the location at which the renewable energy technology is produced. Renewable energy technologies that are produced in Germany would result in less emissions than those that are produced in China. This is because China mainly uses coal for electricity production whereby Germany generates its electricity majorly from natural gas and nuclear. Therefore for a more detailed study, emissions as a result of

cultivation, transportation, manufacturing and decomposition should be considered so as to have a clearer picture of the GHG emission situation in Nigeria.

3.6.4 Transformation Data

Electricity generation data from the existing power plants such as hydro and natural gas and as well as future power plants like small hydro, solar, biomass, nuclear and, wind are given in Tables 3-5.

In these tables merit order indicates the order in which power plants were dispatched. Power plants that have the lowest merit order were dispatched first (base load) and those with the highest merit were dispatched last (peak load). A value of 1 was set to baseload power plants and a merit order of 2 was used for peak power plants. In carrying out this study the merit order of the power plants was ranked based on ascending order of price, this will result in an economically ideal power supply (Next, 2017). The wind, solar, biomass, nuclear and coal power plants, which produce electricity at very low prices, are switched first to supply electricity. Afterwards, the natural gas power plants which have higher marginal costs are increased subsequently until the demand is met. Exogenous capacity refers to the existing capacity added or retired of the power plants. Endogenous capacity is the capacity of the power plants to be introduced. Maximum availability is the ratio of the maximum energy that is produced to what would have been produced if the power plants ran at full capacity for a given period and is expressed in percentage. Process efficiency is defined as the percentage ratio of energy output to feedstock energy input was set in the system.

The data was obtained from the following sources such as Power Holding Company of Nigeria (PHCN, 2010), National Control Centre (NCC, 2010), Projected Costs of Electricity (IEA, 2010), Economic Outlook, Volume 2010 Issue 1 - Statistics (OECD 1, 2010), Updated Capital Costs for Utility Scale Electricity Generating Plants (EIA, 2013). Energy Policies for Sustainable Development Strategies (Emodi, n.d.), and Cost and Performance Data for Power Generation Technologies from the National Renewable Energy Laboratory (NREL, 2012).

Table 3: Electricity Generation Data for Existing Power Plants

Power Plant	Exogenous Capacity (MW)	Historical Production (MWh)	Maximum Availability (%)	Process Efficiency (%)	Merit Order
Natural Gas	3,517	17,360,102.31	95	58	2
Hydro	1,308	6,415,848	69	59	1

Table 4: Electricity Generation Data for Future Power Plants

Power Plant	Maximum Availability (%)	Process Efficiency (%)	Merit Order
New Coal 1000 MW	80	42	1
New Coal 500MW	80	42	1
New Nuclear	90	36	1
New Small Hydro	60	60	1
Solar PV	42	15	1
Biomass	83	80	1
Wind	43	27	1

Table 5: Costs of the Electricity Generating Technologies

Power Plant	Capital (\$/MW)	Variable O&M (\$/KW)	Fixed O&M (\$/KW)
Natural Gas	1230	0.00367	6.31
Hydro	3500	0	15
New Coal 1000 MW	2890	0.00371	62.3
New Coal 500MW	2890	0.00371	62.3
New Nuclear	5530	0.00214	93.28
New Small Hydro	2500	0	53
Solar PV	5950	0	50
Biomass	3830	0.0015	95
Wind	2077	0	25.4

3.6.5 Fuel Costs

The fuel prices used in LEAP were obtained from the Projected Costs of Generating Electricity which is a report made by IEA and the OECD Nuclear Energy Agency

(NEA), (IEA, 2010). Table 6 consists of the costs of the different fuels used. Costs for hydro, solar, wind and biomass to an extent are virtually free.

Table 6: Fuel costs

Fuel Type	Cost
Coal Bituminous	14.63 \$/Metric Tonne
Natural Gas	3.6 \$/Gigajoule
Nuclear	7 \$/MWh

3.7 BAU, EC, and REN Scenarios Design

The design of BAU, EC, and REN Scenarios are explained in detail this section. These scenarios were developed based on the Federal Government of Nigeria's policies towards the expansion of existing power supply, energy conservation and renewable energy.

3.7.1 BAU Scenario

The BAU scenario was developed based on the path that electricity demand and supply policies will continue in the future in the same way they were in the past. All the variables and parameters are assumed to follow the past trend. This includes efficiencies, generation technologies as well as transmission and distribution losses. In the BAU scenario, demographic and economic data used consists of a population growth at 2.55 percent, income growth at 8.6 percent, share of urban population at 50 percent by 2040. Electricity access in the urban areas will increase to 90 percent by 2030 from 79.8 percent while that in the rural areas will attain 60 percent in 2030 from 34.9 percent. In the BAU scenario, there would be the addition of nuclear power plants with a capacity of 1200 MW by 2025, two 1000MW and 500MW coal power plants will be introduced in 2014 and 2015 respectively. The current hydro and gas power plants will be expanded to a capacity of 13000 MW and 9000 MW by 2040 respectively. Transmission and distribution losses will remain at 17 percent.

3.7.2 EC Scenario

Energy conservation is very important because energy consumption and the need for power generation expansion are significantly reduced. The EC scenario was

formulated from energy conservation documents such as NREEP, SE4ALL-AA, and REMP. This scenario shows us how electricity demand and supply will evolve in the future if energy efficiency measures as stipulated by the documents mentioned above are implemented. The following information was used to develop the EC scenario:

- Usage of efficient lighting will attain 40 percent by 2020 and 100 percent by 2040.
- Efficiency of energy intensive technologies will reach to 20 percent by 2020 and to 50 percent by 2030.
- Transmission and distribution losses will be reduced from 17 percent in 2010 to below 10 percent by 2030 (8 percent is chosen).

3.7.3 REN Scenario

As stated earlier, Nigeria has abundant renewable energy resources such as solar, wind, hydro, and biomass. Therefore, taking advantage of these available resources for electricity generation is a priority for the Nigerian government in terms of energy security and reduction in GHG emissions.

The REN scenario is made up of introduction of renewable power plants and no new gas power plants in future. NREEP and REMP were used in developing scenarios with the following technologies listed below:

- Hydro power plants will attain 9000 MW by 2040
- Small hydro power plants will grow to 8173.81 MW by 2030
- Solar PV will attain 6831 MW by 2030
- Introduction of 1200 MW nuclear power plant in 2025
- Biomass will attain 292 MW by 2030
- Wind will attain 3211 MW by 2030

Chapter 4

Results and Discussions

This chapter outlines the results of the LEAP simulations for the three scenarios explained above (BAU, REN, EC). Electricity supply and demand, cost analysis and their emission results corresponding to these scenarios are investigated in detail in this chapter.

4.1 Electricity Demand Projections

The electricity demand of the three scenarios were projected from the base year of 2010 to the target year 2040. Electricity demand in the three scenarios has continuously increased up until 2040 as depicted in Appendix A1-A2. This is attributed to increase in population, urbanization, income growth rate and increase in GDP. Electricity demand in the BAU and REN scenarios increased from 35.9 billion kWh in 2010 to 283.6 billion kWh by 2040 as shown in Fig 19. On the other hand, electricity demand in EC scenario increased from 35.9 billion kWh in 2010 to 233.8 billion kWh as given in Figure 20. Figure 21 compares the electricity demand of the three different scenarios; BAU, EC, and REN.

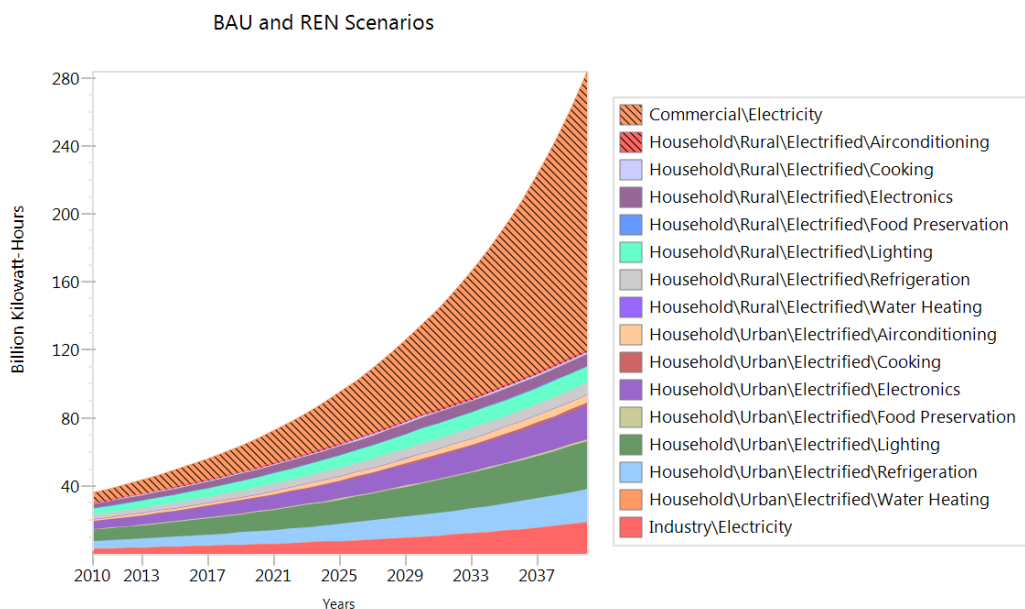


Figure 19: BAU and REN Electricity Demand Projections for Each Sector.

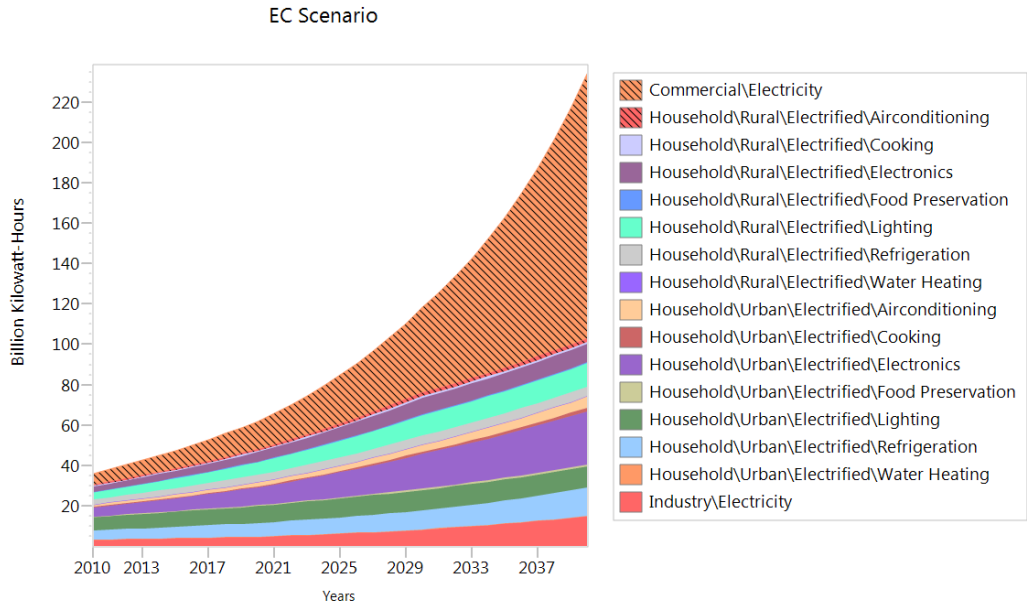


Figure 20: Energy Conservation Electricity Demand Projection for Each Sector.

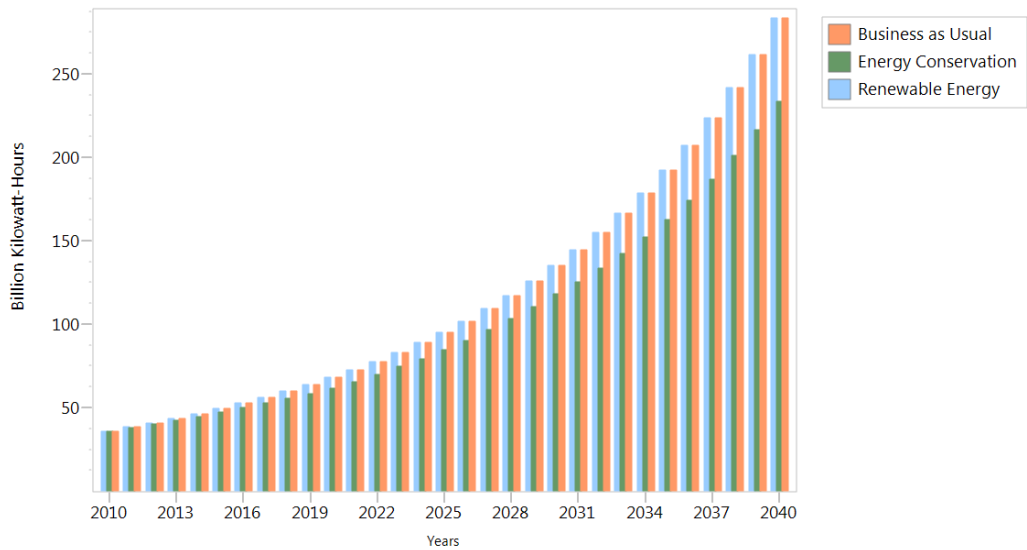


Figure 21: Electricity Demand projection for BAU, EC, and REN scenarios

From the electricity demand in the BAU and REN scenarios, we see that urban households have the highest share of electricity demand in the base year 2010, with a total electricity demand of 17.4 billion kWh while rural constitutes 9.9 billion kWh

(Figure 19). The majority of the electricity demand in the urban households comes from lighting which accounts for 6.6 billion kWh in the base year, 2010. Other high electricity demand sectors are refrigeration (4.5 billion kWh), rural lighting (3.7 billion kWh) and rural refrigeration (2.5 billion kWh). Electricity consumption in the commercial and industrial sectors are 5.5 billion kWh and 3.2 billion kWh respectively. The electricity demand increased to 283.6 billion kWh in 2040, with the urban electricity demand constituting 75.3 billion kWh, lighting constituting 28.3 billion kWh. Demand for lighting in the rural areas increased to 9.7 billion kWh as well. Electricity demand in industrial and commercial sectors massively increased to 18.6 billion kWh and 163.4 billion kWh, respectively.

The demand for electricity in the EC scenario considerably reduced because of the energy efficiency measures taken as well as the reduction of transmission and distribution losses. By 2040, the electricity demand for the EC is 233.8 billion kWh which is a 49.8 billion kWh saving compared to BAU or REN scenarios. The urban household electricity demand is reduced to 59.3 billion kWh under the EC scenario, electricity demand of the rural areas is 28.9 billion kWh, industry is 14.9 billion kWh, and commercial is 130.7 billion kWh. The commercial sector takes the largest share of electricity demand at 55.9 %, subsequently followed by urban house 25.4 %, rural household 12.3 %, and industry 6.4 % as given in Figure 22. The introduction of energy efficient technologies reduced the electricity demand for lighting to 10.2 billion kWh in the urban households but will be overtaken by electronics whose electricity demand will be 26.4 billion kWh. Even though the lighting in rural areas has been reduced, it takes up the largest share of the electricity demand in the rural areas in 2040 (11.5 billion kWh).

Energy Conservation Scenario, All Fuels, All Output types

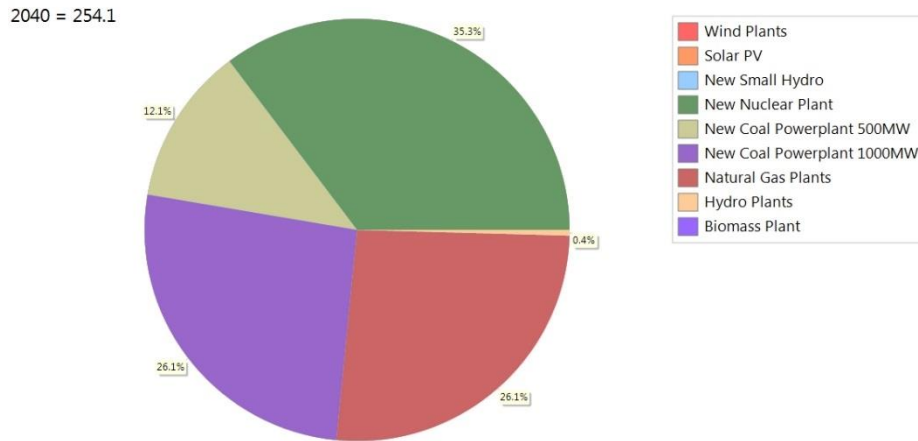


Figure 22: EC electricity demand share by 2040

4.2 Electricity Supply Projections

The power supply in base year of 2010 is made up of gas and hydro power plants only. The electricity supply in the base year stands at 23.8 billion kWh which does not meet the required electricity demand in the base year. This shortage is the reason behind power outages in Nigeria. But with the introduction of new power plants and expansion of the existing ones as formulated in the BAU, EC and REN scenario the electricity supply will match the electricity demand as highlighted in the coming sections.

4.2.1 BAU Electricity Supply

Electricity supply in 2010 for BAU is 23.8 billion kWh, which is made up of electricity supply from hydro and natural gas power plants. As given in Appendix B1, natural gas power plants supplied 17.4 billion kWh and hydro power plants supplied 6.4 billion kWh. Electricity supply in the BAU scenario increased from 23.8 billion kWh to 341.7 billion in 2040 as shown in Figure 23. The Sankey diagram shows the energy flow process in 2040 (Figure 24). In 2025, with the addition of other electricity supply technologies such as coal power plants, the expansion of the existing hydro and natural gas power plants and new nuclear power plants, the electricity supply attained 114.7 billion kWh. By 2040 electricity supply mix for the BAU is made up of nuclear power plants which supplied 139 billion kWh, the new 1000 MW coal power plant supplied 102.9 billion kWh, the new 500 MW coal power plant supplied 51.5 billion kWh and

natural gas power plants supplied 2 billion kWh. In 2040, the share of power supply from nuclear is 40.7%, from 1000 MW coal power plant is 30.1 %, from natural gas plants is 0.6 % and from the 500 MW coal power plant is 15.1 % as given in Figure 25.

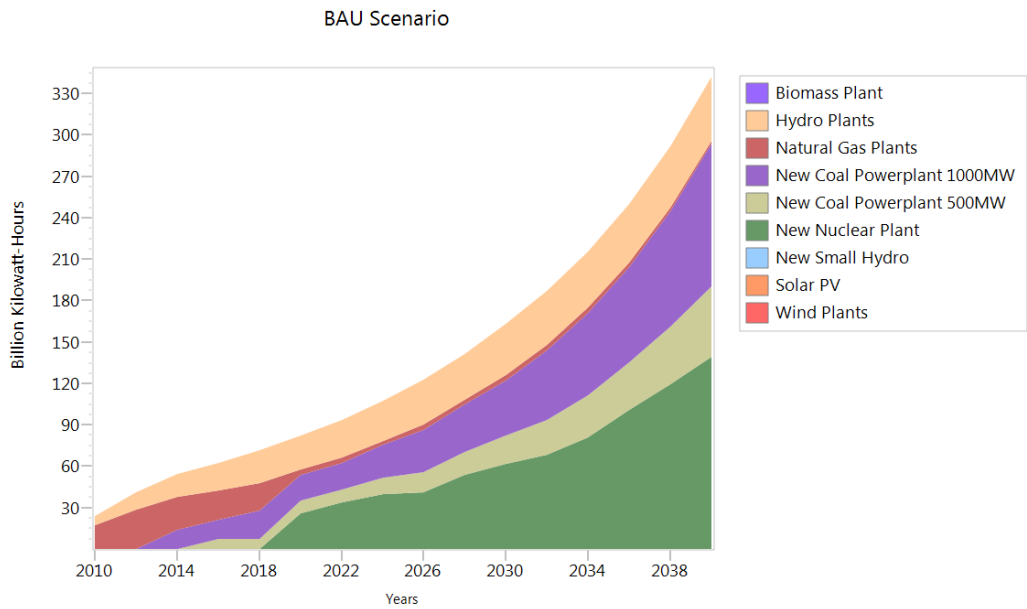


Figure 23: BAU Electricity Supply

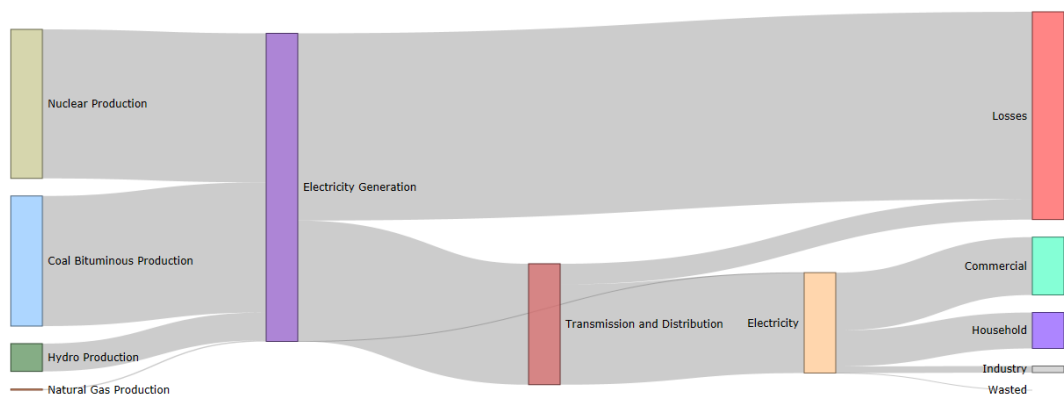


Figure 24: BAU Sankey Diagram 2040

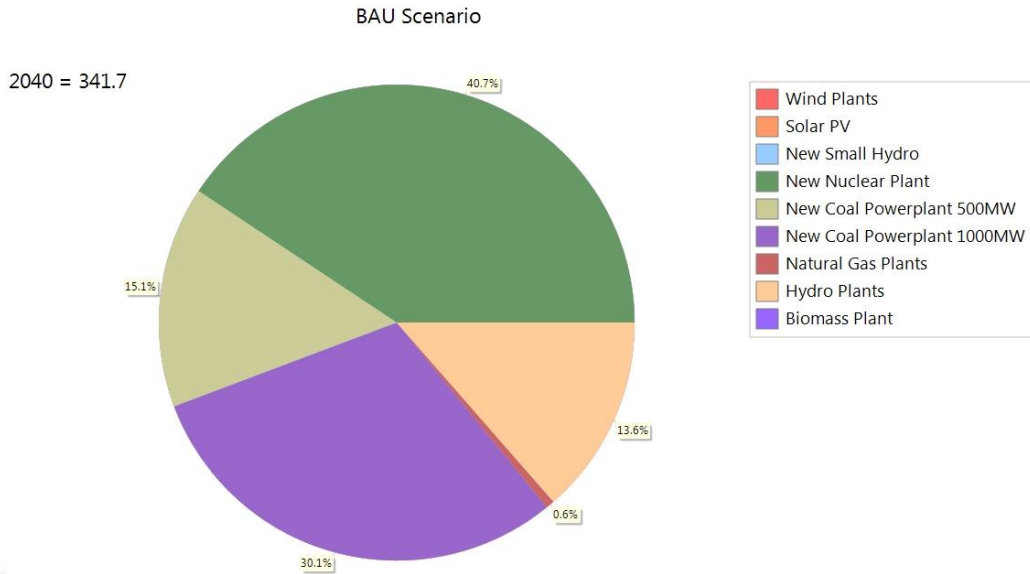


Figure 25: BAU Electricity Supply Mix in 2040

4.2.2 REN Electricity Supply

Electricity supply in the REN scenario increased from 23.8 billion kWh to 336.1 billion in 2040 as given in Figure 26. The Sankey diagram shows the energy flow process in Figure 27. Starting from 2025, the electricity supply mix contained all the electricity supply technologies such as small hydro power plants, biomass power plants, solar PV, nuclear power plants, wind power plants, hydro power plants. The capacity of the natural gas power plants was not increased in the REN scenario. By 2040 as given in Appendix B2, the electricity supply mix for the REN scenario is made up of new small hydro power plants which supply 114 billion kWh, the new nuclear power plant which supplies 77.6 billion kWh, the solar PV plant supplies 53.5 billion kWh, wind power plants supplied 31.3 billion kWh, biomass power plants supplied 5.2 billion kWh, natural gas power plants supplied 2.8 billion kWh, and hydro supplied 51.7 billion kWh. In 2040, the supply from small hydro power plants reached 33.9 % of the electricity mix, nuclear is 23.1 %, solar PV plants are 15.9 %, wind power plants are 9.3 %, gas power plants are 0.8 %, hydro is 15.4 %, and biomass plant is at 1.5 % as given in Figure 28.

REN Scenario

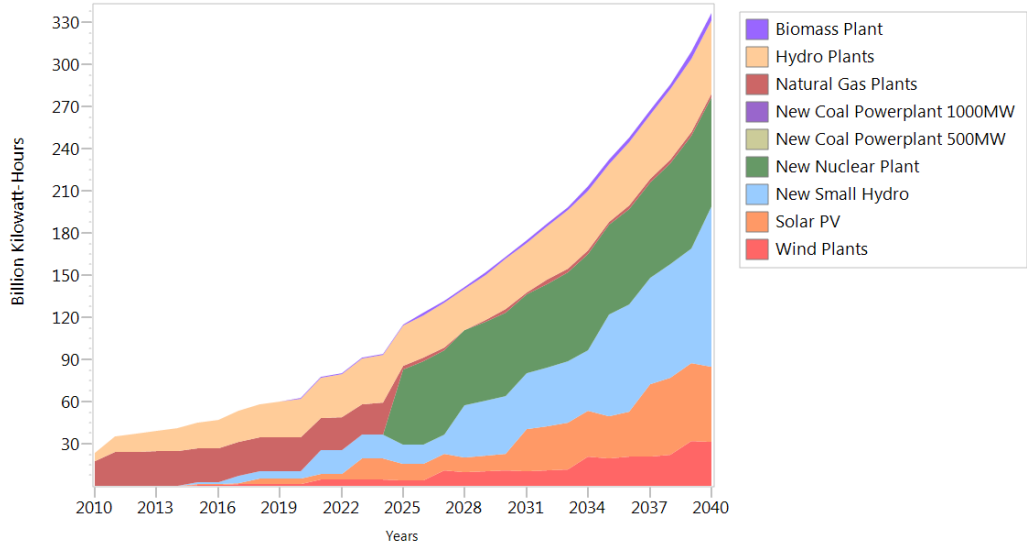


Figure 26: REN Electricity Supply

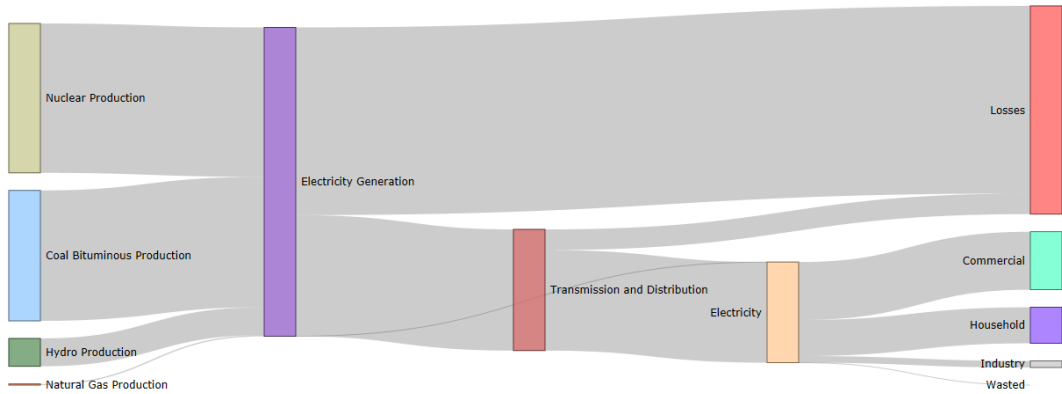


Figure 27: REN Sankey Diagram for 2040

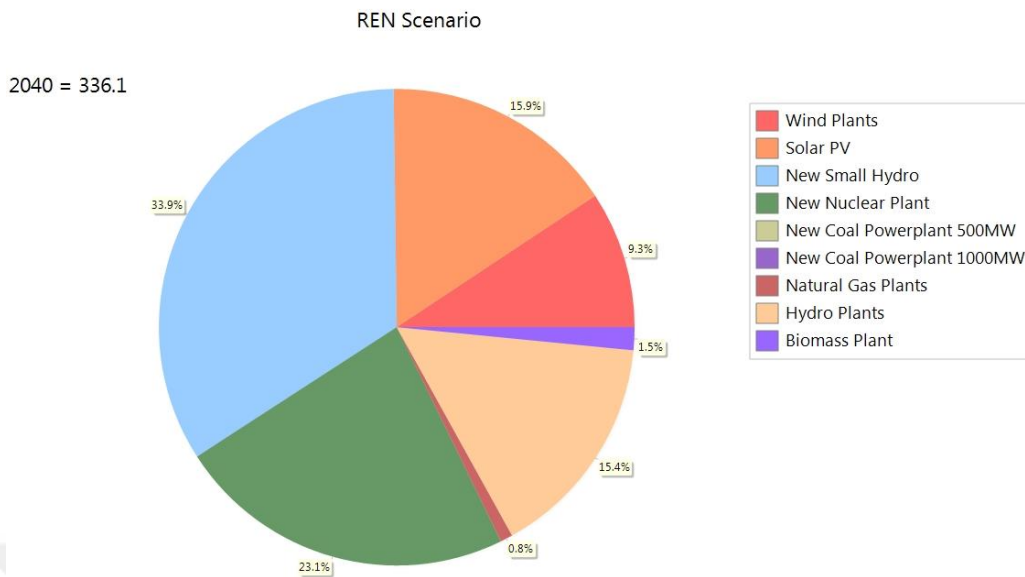


Figure 28: REN Electricity Supply Mix

4.2.3 EC Electricity Supply

Electricity supply for the EC scenario attained 254.1 billion kWh in 2040 as given in Figure 29. The Sankey diagram shows the energy flow process for this scenario in Figure 30. This clearly shows a massive reduction in electricity supply of 87.6 billion kWh in 2040 when compared to the BAU scenario and a reduction of 82 billion kWh in 2040 when compared to the REN scenario. By 2040 as given in Appendix B3, the electricity supply mix for the EC is made up of nuclear power plants, which supply 96.2 billion kWh, the new 1000 MW power plant supply 71.3 billion kWh, the 500 MW coal power plant supply 32.9 billion kWh, natural gas power plants supply 4.3 billion kWh, and hydro power plants supply 49.4 billion kWh. In 2040, the supply from nuclear is 37.9 % of the electricity mix, the 1000 MW coal power plant is 28.1 %, natural gas plants is 1.7 %, and 500 MW coal power plant is 12.9 %, and the hydro power plant is 19.4 % as given in Figure 31.

EC scenario

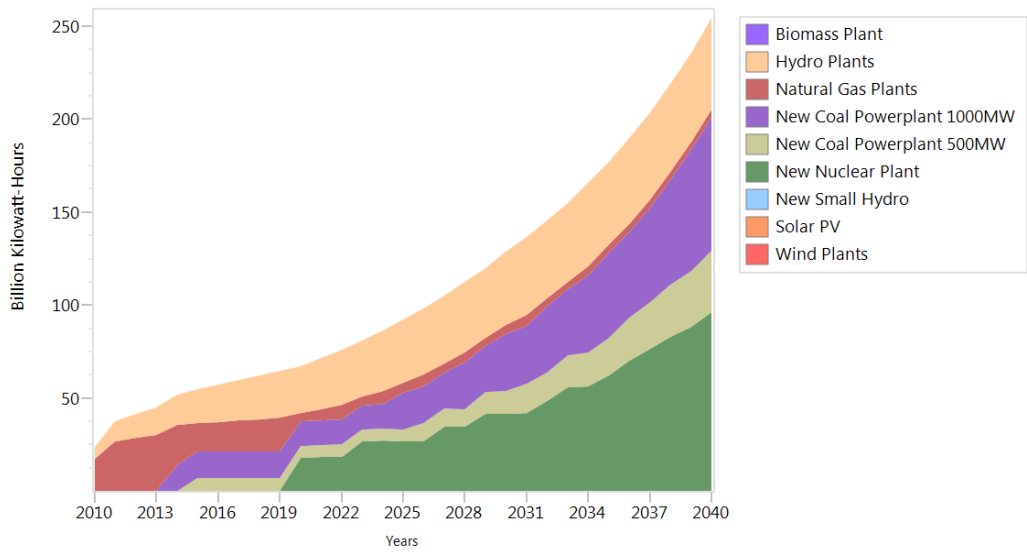


Figure 29: EC Electricity Supply

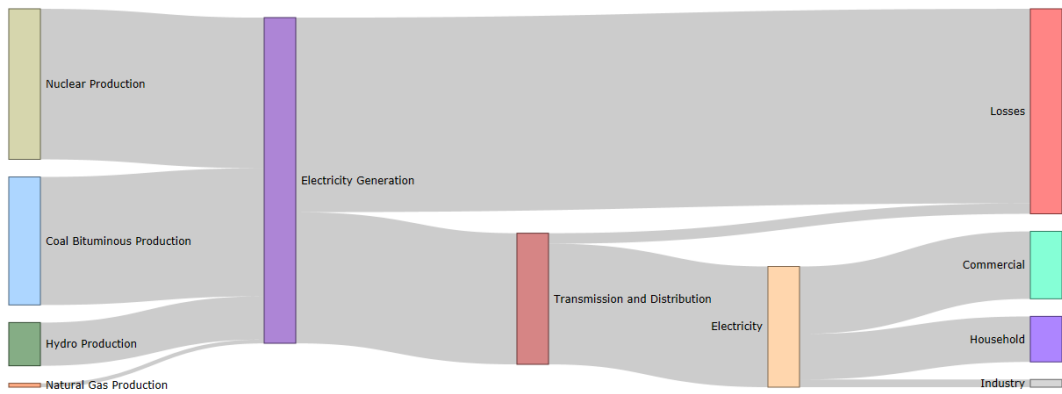


Figure 30: EC Sankey Diagram for 2040

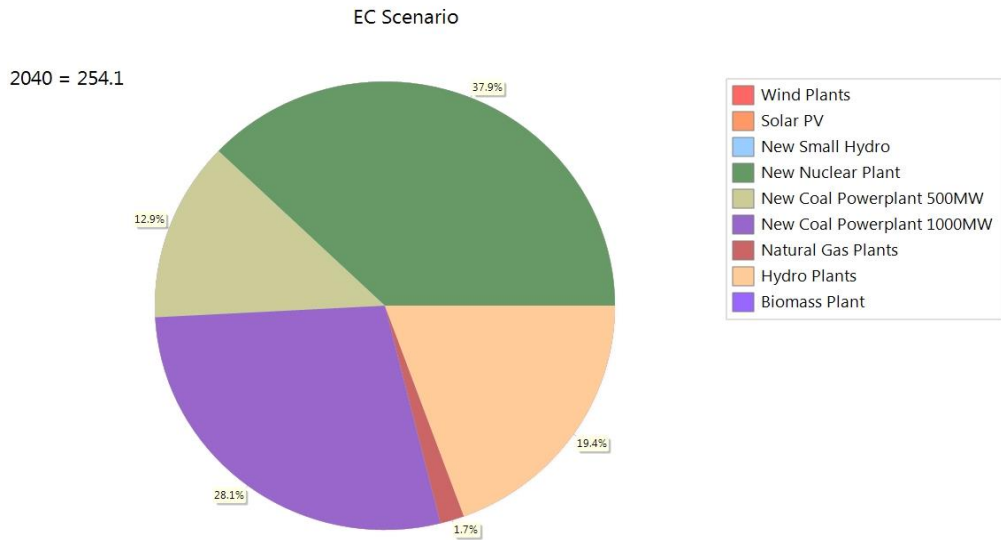


Figure 31: EC Electricity Supply Mix

4.3 GHG Emission Analysis

The Greenhouse Gas (GHG) emissions of the BAU, EC, and REN scenarios for the study carried out are given Figure 32. GHG emissions are measured in million metric tonnes of carbon dioxide (CO₂) equivalent. GHG emissions from the power generating plants in the BAU scenario increased from 6 million metric tons of CO₂eq to 123.9 million metric tons of CO₂eq. Carbon dioxide takes the major chunk of the GHG but there are other gasses such as methane and nitrous oxide. The rapid increment in the GHG for the BAU is due to the addition of coal power plants and expansion of the capacity of the gas power plants. The 1000 MW and 500 MW coal power plants emit the largest quantities of GHG emissions with 82.1 million metric tons of CO₂eq and 41.1 million metric tons of CO₂eq respectively. Natural gas power plant has the least emission when compared to the coal power plants being 0.7 million metric tons of CO₂eq because natural gas has less GHG emissions than coal. The GHG emissions in the EC scenario is 84.6 million metric tons of CO₂eq which is a reduction of 31.7 % amounting to 39.3 million metric tons of CO₂eq compared to the BAU scenario. Reduction in GHG from the EC scenario is as a result of energy efficiency measures taken which led to reduction in electricity demand and supply. The 1000 MW coal power plant introduced is the largest contributor of the GHG emissions. Emissions grew from 11.2 million metric tons of CO₂eq to 56.9 million metric tons of CO₂eq

producing 67.2 % of GHG emissions by 2040. On the other hand, emissions from the 500 MW coal power plant reached 26.3 million metric tons of CO₂eq accounting for 31 % of the GHG emissions. Natural gas power plants emit 1.5 million metric tons of CO₂eq which is 1.8 % of the emissions. The natural gas power plants have the least GHG emission because natural gas has less emissions when compared to coal.

The REN scenario has the least emissions of the three scenarios: BAU, EC, and REN. The REN scenario has the least emissions because coal power plants were not included into the scenario and the capacity of natural gas power plants were not increased. Therefore, the REN scenario will have electricity supply from wind, solar, hydro, nuclear, biomass and natural gas power plants. With the exception of biomass and natural gas power plants, the remaining power plants do not emit any GHG gasses. Natural gas power plants emit the largest share of GHG amounting to 975.1 thousand metric tons of CO₂eq with biomass emitting 43.8 thousand metric tons of CO₂eq. The total cumulative amount of GHG emissions by REN scenario is 1,018.9 thousand metric tons of CO₂eq. The cost required in reducing the GHG emissions in the REN scenario is 13.57 USD/tCO₂eq. The cumulative amount of GHG emissions that would be released by the BAU scenario is 1,414.5 million tons of CO₂eq, for EC is 1,004.8 million tons of CO₂eq and for the REN scenario is 134.62 million tons of CO₂eq.

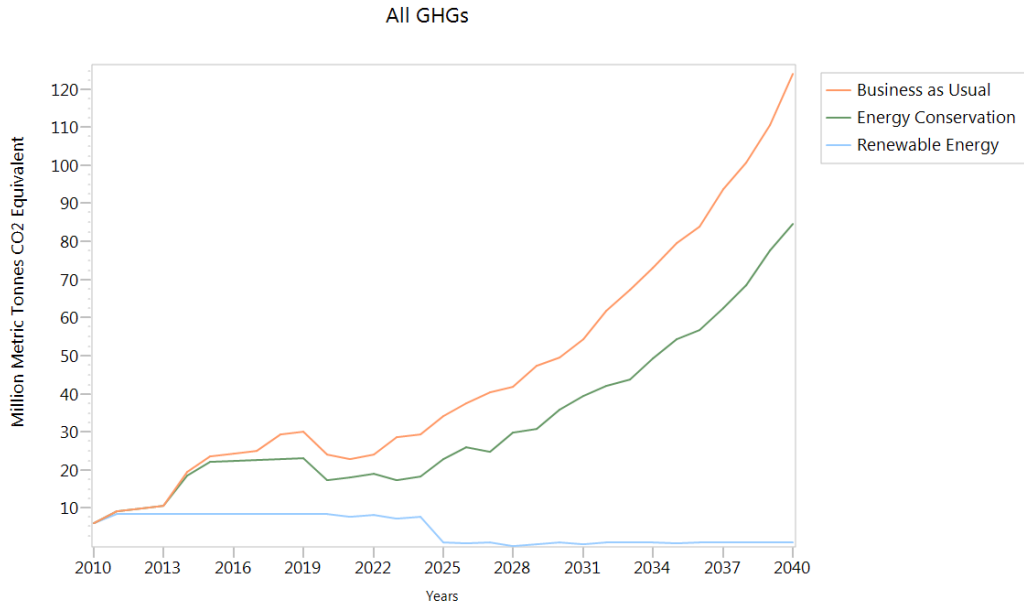


Figure 32: GHG Emission of BAU, EC, and REN

4.4 Cost Analysis of BAU, EC and REN Scenarios

According to (Heap, 2015) in order to view the result of the cost analysis graphically, the costs should be viewed in terms of differences with respect to the Reference scenario (BAU).

The cumulative net present value (NPV) of the capital costs in billion USD from 2010 to 2040 of the EC and REN scenarios compared to the BAU scenario is given in Figure 33. The cumulative capital cost of the EC reached a negative 44.2 billion USD by 2040. This means that the capital cost of the EC scenario is 44.2 billion USD less than the BAU scenario in 2040 (160.2 billion USD). The REN scenario on the other hand has a positive cumulative capital cost of 56.3 billion USD, which means that the REN scenario is 56.3 billion USD more than the BAU scenario. The REN scenario is the most expensive scenario in terms of capital costs, while the EC scenario has the least capital costs. The high costs of the REN scenario are attributed to the higher capital costs of the renewable energy electricity generation power plants being introduced.

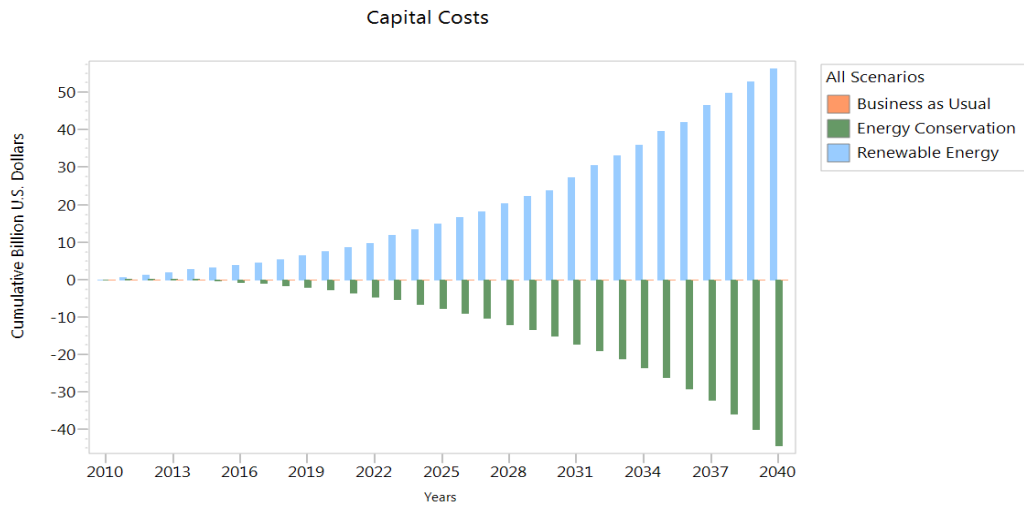


Figure 33: Comparison of the capital costs of the EC and REN scenarios with BAU

Figure 34 shows the cumulative (NPV) of the fixed O&M costs from 2010 to 2040 in billion USD. REN scenario has a positive NPV of 4.1 billion USD and EC has a negative NPV 15 billion USD in 2040. The REN scenario has the highest fixed O&M costs compared to EC and BAU scenarios.

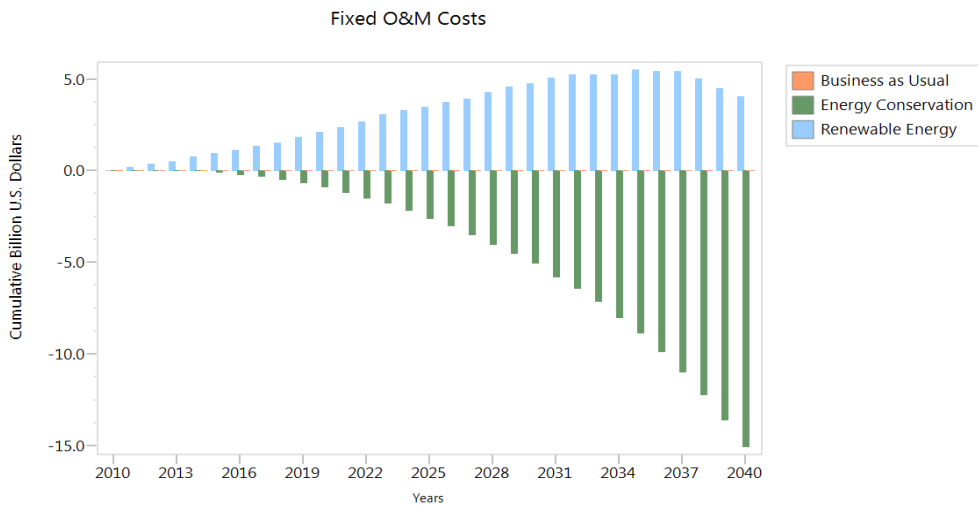


Figure 34: Comparison of the Fixed O&M costs of the EC and REN scenarios with BAU

Figure 35 shows that the both REN and EC scenarios have a cumulative variable O&M cost less than that of the BAU scenario. REN scenario has a negative NPV of 789.4 million USD, EC on the other hand has negative NPV of 263 million USD as of 2040. The REN scenario has the lowest variable O&M costs mainly attributed to the fact that

renewable energy power plants utilize the naturally available energy resources that are available at no costs.

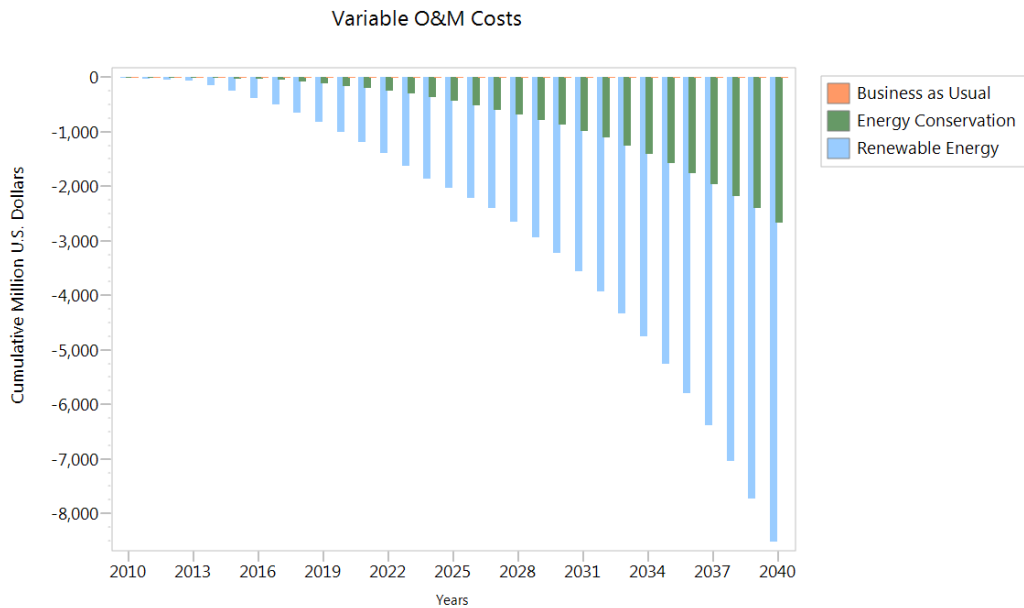


Figure 35: Comparison of the Variable O&M costs of the EC and REN scenarios with BAU

The REN scenario will also cost 13.57 USD/tCO₂eq more than the BAU scenario in avoiding GHG emissions while the EC will cost 61.3 USD/tCO₂eq less than the BAU scenario.

Considering the NPV of each scenario, the REN is the most expensive scenario with a NPV of 114.79 billion USD then the BAU scenario with a NPV of 97.43 billion USD and the EC scenario with a NPV of 72.32 billion USD.

Chapter 5

Conclusion and Policy Recommendations

5.1 Conclusion

The main objective of this study was to find a solution to the never-ending power outages in Nigeria. Therefore, three scenarios which are BAU, EC and REN were generated. Projections of the three scenarios in terms electricity demand and supply, GHG emissions and costs analysis were made using Long Range Energy Alternatives Planning (LEAP). These projections were used to compare the three scenarios and to decide which path should be followed to meet the growing electricity demand.

The growth in electricity demand in the BAU and REN scenarios is attributed to the electricity access targets set by the Federal Government of Nigeria, which has increased the demand in both the urban and rural areas. In addition, there is also surge in electricity demand for the industrial and commercial sectors. Electricity demand in the BAU and the REN scenarios reached 283.6 billion kWh in 2040. This demand was 233.8 billion kWh by 2040 in the EC scenario which is 17.55 % lower compared to the BAU and REN scenarios. This reduction of electricity demand by the EC scenario is because of more efficient use of electricity and reduced losses in transmission and distribution.

This reduction of electricity demand in the EC scenario is a major advantage over the BAU and REN scenarios. This is because less electricity demand leads to a reduction in the amount of electricity to be supplied. The electricity supply in the EC scenario is 254.1 billion kWh, 341.7 billion kWh in the BAU scenario and 336.1 billion kWh in the REN scenario by 2040. This clearly shows that there is a 25.6% and 24.4% of reduction in the amount of electricity to be supplied in EC scenario when compared to BAU and REN scenarios respectively. This reduction in the supply of the EC scenario will reduce the need for expansion and introduction of new power plants, and this will lead to significant savings on investments for power infrastructure by the Federal Government of Nigeria.

The REN scenario has the least net GHG emissions with 134.62 million tons of CO₂eq when compared to BAU that has 1,414.5 million tons of CO₂eq and EC with 1004.8 million tons of CO₂eq. The EC scenario emits 28.96 % less GHG than the BAU because of the reduction in capacity of the power plants in the EC scenario. The REN scenario emits less GHG emissions which leads to a reduction in human hours lost and deaths due to disease from the GHG emissions. However, the reduction of GHG emissions of the REN scenario is obtained at a cost of 13.57 USD/tCO₂eq more than the BAU scenario.

The REN scenario is the most expensive scenario when compared to the BAU and EC scenarios in terms of NPV, capital and fixed O&M costs but has the least variable O&M costs (small compared to capital and fixed O&M costs) because of its utilization of the available free natural resources. The utilization of renewable energy resources which are abundantly available in Nigeria will lead to energy security and reduce the need for imports when Nigeria's oil, natural gas and coal reserves are depleted in the coming decades. The socio-economic aspect of the REN scenario is attractive because of the amount of jobs that will be created by the renewable energy sector in Nigeria. As reported by Samuelson (2017) the renewable energy sector is creating jobs at a rate 12 times faster than other sectors in the United States economy. But for a growing economy like Nigeria that is facing economic challenges due to its heavy reliance on fossil fuels for which it has no control over its price, the REN scenario will be unrealistic. The EC scenario is the most attractive one in terms of costs in trying to meet the electricity demand and eradicate power outages.

Comparing the BAU, EC and REN scenarios, the EC scenario is the most realistic and suitable path for Nigeria to follow in order to meet its growing electricity demand. This was acknowledged by a study carried out by the Energy Commission of Nigeria, that adopting energy efficiency to conserve energy is the way forward to solve Nigeria's growing electricity demand (Sambo, 2008). In this regard, the Government of Nigeria established the National Centre for Energy Efficiency and Conservation at the University of Lagos. The Centre was established to conduct research in energy efficiency and conservation.

5.2 Policy Recommendations

We can make the following policy recommendations based on the results of this study, especially based on EC scenario:

- High taxes should be imposed on imported electric appliances that are not classified as being efficient.
- More than 50 percent of households in Nigeria are not metered and this has led to wastages and an up rise in demand. The distribution companies should ensure that all households are metered which will lead to a reduction in the amount of electricity that is being consumed.
- Establishment of companies should be encouraged to manufacture efficient light bulbs, efficient refrigerators, efficient air conditioners etc. in Nigeria.
- Development of energy efficient buildings and upgrading of the existing ones should be encouraged so as to reduce the amount of electricity that is being consumed by cooling.
- Government should enforce and monitor energy efficiency polices.

References

1. Abdulrahim A.T., Diso I.S., El-Jumamah A. M., (2010). 'Solar Concentrators' Developments in Nigeria: A review.', *Continental J. Engineering Sciences*, Volume 5(2141 - 4068), pp. 38 – 45.
2. Adedokun, A., (2016). Nigeria electricity forecast and vision 20: 2020: Evidence from ARIMA model. *Energy Sources, Part B: Economics, Planning, and Policy*, 11(11), pp.1027-1034.
3. Adekanmi. A. A, Ogunleye. P.O, Damagum, A.H. and Olaseheinde, O., (2007). Geochemical map of uranium distribution in the residual soil of GRN cell number N08 E05. Unpublished Report Nigerian Geological Survey Agency.
4. Ajayi, O.O, (2010). The Potential for Wind Energy in Nigeria. *Wind Engineering*. 2010, Volume 34, 303–312.
5. Akubo S., Dongo E.I., Momoh I.M., Okorie N.N., Oluyori R.T., (2013) 'Revitalization of the Nigerian coal mining industry to expand the power generation needs of Nigeria ', *Journal of Research in Environmental Science and Toxicology*, V.2(8) (2315-5698), pp. 175-178.
6. A.S. Sambo, (2005). 'Renewable Energy for Rural Development: The Nigerian Perspective ', *ISESCO Science and Technology Vision*, Volume 1, pp. 12-22
7. Audu Nathan Pelesai, Apere, (2013). 'The Dynamics of Demand and Supply of Electricity in Nigeria', *Developing Country Studies*, Vol.3, No.3 (2225-0565), pp. 25-36.
8. Cervigni, R., Dvorak, I., Cervigni, R. and Rogers, J. (2013). *Assessing Low-carbon Development in Nigeria: An Analysis of Four Sectors (A World Bank Study)*. The World Bank Group.

9. Caleb A. Amlabu, Jonathan U. Agber, Cletus O. Onah, Suberu Y. Mohammed (2013). 'Electric Load Forecasting: A Case Study of the Nigerian Power Sector', *International Journal of Engineering and Innovative Technology (IJEIT)*, Vol.2(2277-3754), pp. 23-27.
10. Chel and Kaushik, (2011). *Renewable energy for sustainable agriculture. Agronomy for Sustainable Development*, Springer Verlag/EDP Sciences/INRA, 31 (1), pp.91-118.
11. CIA, (2016). *The World Fact book — Central Intelligence Agency*. [online] Available at: <https://www.cia.gov/library/publications/the-world-factbook/rankorder/2241rank.html> [Accessed 13 Jun. 2017].
12. Claudius A. Awosope, (2014). 'Nigeria Electricity Industry: Issues, Challenges and Solutions', *Public lecture series, Volume (2006 - 0327)*, pp. 1 - 40.
13. *Consumption of Oil Products*, (2016). [ebook] International Energy Agency, p.1. Available at: <http://www.iea.org/stats/WebGraphs/NIGERIA1.pdf> [Accessed 26 May 2017].
14. de Almeida, A., Fonseca, P., Schlomann, B. and Feilberg, N., (2011). *Characterization of the household electricity consumption in the EU, potential energy savings and specific policy recommendations. Energy and Buildings*, 43(8), pp.1884-1894.
15. Egan, M., (2016). *Why oil could return to \$30 a barrel this year*. [online] CNN Money. Available at: <http://money.cnn.com/2016/06/14/investing/crude-oil-30-dollars-morgan-stanley/index.html> [Accessed 13 May. 2017].
16. Emodi, N., Emodi, C. and Emodi, A., (2016). *Sustainable Strategies for Low Carbon Development in Nigeria. Journal of Scientific Research and Reports*, 10(6), pp.1-10.

17. Emodi, N., Emodi, C., Murthy, G. and Emodi, A., (2017). Energy Policy for Low Carbon Development in Nigeria: A LEAP model application. *Renewable and Sustainable Energy Reviews*, 68, pp.247-261.
18. Emodi, N. (n.d.). *Energy policies for sustainable development strategies*.
19. Energy Consumption by sector in Nigeria, (2010). [ebook] International Energy Agency, p.1. Available at: <http://www.iea.org/stats/WebGraphs/NIGERIA3.pdf> [Accessed 26 May 2017].
20. Energy Commission of Nigeria (ECN), (2007). Draft Energy Masterplan.
21. Energy Production in Nigeria, (2016). [ebook] International Energy Agency, p.1. Available at: <http://www.iea.org/stats/WebGraphs/NIGERIA3.pdf> [Accessed 26 May 2017].
22. Energy Statistics Database, Available at: unstats.un.org/unsd/energy/edbase.htm Energy Statistics Database (Accessed: 26 May 2017).
23. Enibe, S.O and Odukwe, S. A., (1990). Patterns of Energy Consumption in Nigeria. *Energy Conservation and Management*, 30(2): 69-73.
24. Ezennaya O. S., Isaac O. E., Okolie U. O., Ezeanyim O. I. C., (2014). 'Analysis of Nigeria's National Electricity Demand Forecast (2013-2030)', *International Journal of Scientific & Technology Research*, Vol.3(2277-8616), pp. 333-340.
25. Federal Ministry of Power, (2016). Federal Ministry of Power, Works & Housing (Works). [online] Available at: <http://www.works.gov.ng/index?what=4&title=Contact> [Accessed 25 May 2017].

26. Feng, Y.Y, and L.X. Zhang, (2012). "Scenario Analysis of Urban Energy Saving and Carbon Abatement Policies: A Case Study of Beijing City, China". *Procedia Environmental Sciences* 13 (2012): 632-644. Web.
27. FMP, (2015). Federal Ministry of Power: Draft Rural Electrification Strategy and Plan (RESP).
28. Heaps, C.G., (2012). Long-range Energy Alternatives Planning (LEAP) system. [Software version: 2017.0.11] Stockholm Environment Institute. Somerville, MA, USA. <https://www.energycommunity.org>.
29. Heaps, C.G., (2015). Long-range Energy Alternatives Planning (LEAP) system. [Software version: 2017.0.11] Stockholm Environment Institute. Somerville, MA, USA. <https://www.energycommunity.org>.
30. Huld T, Šúri M, Dunlop E, Albuisson M, Wald L, (2005). Integration of HelioClim-1 database into PVGIS to estimate solar electricity potential in Africa. In: *Proceedings of the 20th european photovoltaic solar energy conference and exhibition*. Available online: (<http://re.jrc.ec.europa.eu/pvgis/>); [accessed 29.05.17].
31. IEA, (2010). *Projected Costs of Generating Electricity*, IEA - Report. [online] Available.
32. IEA, (2015). IEA - Report. [online] Available at: <https://www.iea.org/statistics/statisticssearch/report/?country=Nigeria%20&product=balances> [Accessed 29 May 2017].
33. Ileoje, O.C., (1997). Potentials for Renewable Energy Application in Nigeria, Energy Commission of Nigeria, 5 – 16.
34. Ismaila Haliru Zarma, (2006). Hydro Power Resources in Nigeria, being a country position paper presented at 2nd Hydro Power for Today Conference International Centre on Small Hydro Power (IC-SHP), Hangzhou, China.

35. M. Dada, O. (2016). Audit of Electricity Generation in University of Lagos, Nigeria. *International Journal of Energy and Power Engineering*, 5(2), p.29.
36. National Control Centre (NCC), (2010). The Nigeria Electricity System Operator. [online] Available at: <http://www.nsong.org/AboutUs/Structure.aspx> [Accessed 14 Jun. 2017].
37. Nat Met (Nigerian Meteorological Agency) | NIMET. [online] Available at: <http://www.nimet.gov.ng/> [Accessed 24 May 2017].
38. National Renewable Energy and Energy Efficiency Policy (NREEEP), (2015). Energy Commission of Nigeria (ECN) and Federal Ministry of Science and Technology, [Available at: www.energy.gov.ng].
39. National Renewable Energy Laboratory, NREL, (2012). Cost and Performance Data for Power Generation Technologies [online] Available at: <https://www.bv.com/docs/reports-studies/nrel-cost-report.pdf> [Accessed 6 Jun. 2017].
40. NERC, (2011). Presentation at the Electric Power Investor's Forum (February 2011).
41. Next, C. (2017). Merit order curve - Knowledge Hub. [online] Centrali-next.it. Available at: <https://www.centrali-next.it/en/knowledge-hub/merit-order-curve/> [Accessed 8 Jul. 2017].
42. Nigeria Power guide - volume 3, (2015) edition | Lexology. [online] Available at: <http://www.lexology.com/library/detail.aspx?g=f77e24d6-8338-47d6-9e4d-ed5b89a51862> [Accessed 14 Jun. 2017].
43. Nigeria's Total Energy Supply, (2013). [ebook] International Energy Agency, p.1. Available at: <http://www.iea.org/stats/WebGraphs/NIGERIA3.pdf> [Accessed 26 May 2017].

44. NNPC, (2016). Development of the Industry. [online] Available at: <http://nnpcgroup.com/NNPCBusiness/BusinessInformation/OilGasInNigeria/DevelopmentoftheIndustry.aspx> [Accessed 27 May 2017].
45. NNPC, (2016). Refineries & Petrochemicals. [online] Available at: <http://nnpcgroup.com/NNPCBusiness/MidstreamVentures/RefineriesPetrochemicals.aspx> [Accessed 25 May 2017].
46. Obaje, N. (2013). *Updates on the geology and mineral resources of Nigeria*. Abuka, Nigeria: Onaivi Printing & publishing Co. Ltd.
47. OECD I, (2010). OECD Economic Outlook, Volume 2010 Issue 1 - Statistics – OECD I Library. [online] Available at: http://www.oecd-ilibrary.org/economics/oecd-economic-outlook-volume-2010-issue-1_eco_outlook-v2010-1-en [Accessed 14 Jun. 2017].
48. Oramah., (2006). The Effects of Population Growth in Nigeria. *Journal of Applied Sciences*, 6(6), pp.1332-1337.
49. Oyediran Oyelami, B. and Adedoyin Adewumi, A., (2014). Models for Forecasting the Demand and Supply of Electricity in Nigeria. *American Journal of Modeling and Optimization*, 2(1), pp.25-33.
50. Primary Energy Supply in Nigeria, (2016). [ebook] International Energy Agency, p.1. Available at: <http://www.iea.org/stats/WebGraphs/NIGERIA4.pdf> [Accessed 26 May 2017].
51. PHCN, (2010). Power Holding Company of Nigeria - Services Portal. [online] Available at: <http://services.gov.ng/phcn> [Accessed 14 Jun. 2017].
52. Sambo, A.S., (2005). Renewable Energy for Rural Development: The Nigerian Perspective. *ISESCO Science and Technology Vision*, 1, 12-22.

53. Sambo, A. S., (2008). Paper presented at the “National Workshop on the Participation of State Governments in the Power Sector: Matching Supply with Demand”, 29 July 2008, Ladi Kwali Hall, Sheraton Hotel and Towers, Abuja.
54. Samuelson, K. (2017). Renewable Energy Industry Creates Jobs 12 Times Faster Than Rest of U.S.. [online] Fortune.com. Available at: <http://fortune.com/2017/01/27/solar-wind-renewable-jobs/> [Accessed 8 Jul. 2017].
55. Securities & Exchange Commission, Nigeria, (2011). [Accessed at: www.sec.gov.ng/files/Prof%20Nnaji%20Presentation.pdf]. Power Sector Outlook in Nigeria: Governments Renewed Priorities.
56. S. O. Adams, R. O. Akano ,O. J. Asemota, (2011). 'Forecasting Electricity Generation in Nigeria using Univariate Time Series Models ', European Journal of Scientific Research, Vol.58 No.1 (2011), (1450-216X), pp. 30-37.
57. Sustainable Energy for All Action Agenda (SE4ALL-AA), (2016). National Council on Power (NACOP), [Available at: http://www.se4all.org/sites/default/files/nigeria_se4all_action_age}}}}nda_final.pdf].
58. Transmission Plans (2013 -2017) and Evacuation of Niger Delta Power Holding Company (NDPHC) Power Plants Generation (20 Sep 2013 communication).
59. The Renewable Energy Master Plan (REMP), (2013). Federal Ministry of Environment, [Available: https://www.iea.org/publications/freepublications/publication/projected_costs.pdf] [Accessed 3 June 2017].
60. USAID, (2017). Power Africa in Nigeria | Power Africa | U.S. Agency for International Development. [online] Available at: <https://www.usaid.gov/powerafrica/nigeria> [Accessed 26 May 2017].

61. Vincent, E.N. and Yusuf, S.D., (2014). Integrating Renewable Energy and Smart Grid Technology into the Nigerian Electricity Grid System. *Smart Grid and Renewable Energy*, 5, 220-238. <http://dx.doi.org/10.4236/sgre.2014.59021>.
62. Wale Shonibare, (2014). Meeting and sustaining the funding needs for the power sector, UBA Capital Plc; *Power Magazine*, August-October 2013, *Privatizing Nigeria's Power Utilities*, p. 68 and Global Energy Network Institute, (Accessed: 26 May 2017).
63. Webmeets, (2015). Scenario Cost Benefit Analysis of German Electricity Market with New Energy and Environmental Policies, Available at: <http://www.webmeets.com/files/papers/eaere/2015/1089/Scenario%20costbenefit%20of%20Germany%20for%20EAERE%20conferencev1.pdf> (Accessed: 4 June 2017).
64. World Bank, (2015). World Development Indicators | Data. [online] Available at: <http://data.worldbank.org/data-catalog/world-development-indicators#> [Accessed 13 Jun. 2017].
65. World Development Indicators (WDI), (2010). Nigeria | Data. [online] Available at: <http://data.worldbank.org/country/nigeria> [Accessed 14 Jun. 2017].

Appendices

Appendix A: Electricity Demand Tables

A1: BAU and REN Electricity Demand

Energy Demand Final Units							
BAU and EC							
Branch: Demand							
Units: Billion Kilowatt-Hours							
Branches	2010	2015	2020	2025	2030	2035	2040
Household	27.2	35.4	45.4	57.6	72.3	85.7	101.6
Urban	17.4	22.7	29.5	38.1	48.9	60.8	75.3
Electrified	17.4	22.7	29.5	38.1	48.9	60.8	75.3
Lighting	6.6	8.6	11.1	14.4	18.4	22.9	28.3
Refrigeration	4.5	5.9	7.7	9.9	12.7	15.8	19.5
Air-conditioning	1.2	1.5	2.0	2.5	3.3	4.1	5.0
Cooking	0.2	0.3	0.4	0.6	0.8	1.1	1.4
Food Preservation	0.3	0.3	0.4	0.6	0.7	0.9	1.1
Electronics	4.6	6.0	7.8	10.1	12.9	16.1	19.9
Water Heating	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Rural	9.9	12.7	16.0	19.5	23.4	24.9	26.3
Electrified	9.9	12.7	16.0	19.5	23.4	24.9	26.3
Lighting	3.7	4.7	5.9	7.2	8.7	9.2	9.7
Refrigeration	2.5	3.3	4.1	5.0	6.0	6.4	6.7
Air-conditioning	0.6	0.8	1.0	1.3	1.5	1.6	1.7
Cooking	0.3	0.4	0.5	0.7	0.8	0.8	0.9
Food Preservation	0.1	0.2	0.2	0.3	0.3	0.4	0.4
Electronics	2.6	3.3	4.1	5.1	6.1	6.5	6.8
Water Heating	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Industry	3.2	4.3	5.8	7.8	10.4	13.9	18.6
Electricity	3.2	4.3	5.8	7.8	10.4	13.9	18.6
Commercial	5.5	9.6	16.9	29.9	52.6	92.7	163.4
Electricity	5.5	9.6	16.9	29.9	52.6	92.7	163.4
Total	35.9	49.4	68.2	95.2	135.3	192.3	283.6

A2: EC Electricity Demand

Energy Demand Final Units EC scenario Branch: Demand Units: Billion Kilowatt-Hours							
Branches	2010	2015	2020	2025	2030	2035	2040
Household	27.2	34.7	43.5	54.6	67.7	77.4	88.1
Urban	17.4	21.7	27.0	33.8	42.0	50.0	59.3
Electrified	17.4	21.7	27.0	33.8	42.0	50.0	59.3
Lighting	6.6	7.5	8.3	9.3	10.2	10.4	10.2
Refrigeration	4.5	5.6	6.8	8.0	9.2	11.4	14.1
Air-conditioning	1.2	1.6	2.1	2.7	3.6	4.5	5.5
Cooking	0.2	0.3	0.5	0.7	1.1	1.4	1.8
Food Preservation	0.3	0.3	0.4	0.6	0.7	0.9	1.1
Electronics	4.6	6.4	8.9	12.4	17.2	21.3	26.4
Water Heating	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Rural	9.9	13.0	16.6	20.9	25.7	27.4	28.9
Electrified	9.9	13.0	16.6	20.9	25.7	27.4	28.9
Lighting	3.7	4.9	6.3	8.1	10.2	10.9	11.5
Refrigeration	2.5	3.1	3.6	4.0	4.3	4.6	4.9
Air-conditioning	0.6	0.9	1.1	1.4	1.7	1.8	1.9
Cooking	0.3	0.4	0.6	0.7	0.9	1.0	1.0
Food Preservation	0.1	0.2	0.3	0.4	0.5	0.5	0.5
Electronics	2.6	3.5	4.7	6.2	8.1	8.6	9.1
Water Heating	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Industry	3.2	3.9	4.6	6.2	8.3	11.1	14.9
Electricity	3.2	3.9	4.6	6.2	8.3	11.1	14.9
Commercial	5.5	8.7	13.6	23.9	42.1	74.2	130.7
Electricity	5.5	8.7	13.6	23.9	42.1	74.2	130.7
Total	35.9	47.3	61.7	84.7	118.1	162.7	233.8

Appendix B: Electricity Supply Tables

Appendix B1: BAU Electricity Supply

Outputs by Feedstock Fuel							
Business as Usual Scenario, All Fuels, All Output types							
Branch: Transformation\Electricity Generation\Processes							
Units: Billion Kilowatt-Hours							
Branches	2010	2015	2020	2025	2030	2035	2040
Natural Gas Plants	17.4	19.3	3.8	3.3	4.0	3.6	2.0
Hydro Plants	6.4	18.2	24.4	30.4	36.9	42.0	46.3
New Coal Power plant 1000MW	-	14.0	18.9	29.5	40.1	65.3	102.9
New Coal Power plant 500MW	-	7.0	9.5	11.8	20.1	32.7	51.5
New Nuclear Plant	-	-	25.5	39.8	61.9	88.2	139.0
New Small Hydro	-	-	-	-	-	-	-
Solar PV	-	-	-	-	-	-	-
Biomass Plant	-	-	-	-	-	-	-
Wind Plants	-	-	-	-	-	-	-
Total	23.8	58.5	82.2	114.7	163.0	231.7	341.7

B2: REN Electricity Supply

Outputs by Feedstock Fuel							
Renewable Energy Scenario, All Fuels, All Output types							
Branch: Transformation\Electricity Generation\Processes							
Units: Billion Kilowatt-Hours							
Branches	2010	2015	2020	2025	2030	2035	2040
Natural Gas Plants	17.4	24.4	24.3	2.4	2.8	2.3	2.8
Hydro Plants	6.4	18.2	27.1	29.0	35.3	40.6	51.7
New Coal Power plant 1000MW	-	-	-	-	-	-	-
New Coal Power plant 500MW	-	-	-	-	-	-	-
New Nuclear Plant	-	-	-	53.2	59.2	63.9	77.6
New Small Hydro	-	1.3	5.1	13.7	41.5	72.1	114.0
Solar PV	-	0.8	3.9	12.0	11.7	30.1	53.5
Biomass Plant	-	0.1	0.7	0.5	1.6	3.2	5.2
Wind Plants	-	0.3	1.4	3.8	10.9	19.5	31.3
Total	23.8	45.0	62.5	114.7	163.0	231.7	336.1

B3: EC Electricity Supply

Outputs by Feedstock Fuel

Energy Conservation Scenario, All Fuels, All Output types

Branch: Transformation\Electricity Generation\Processes

Units: Million Gigajoules

Branches	2010	2015	2020	2025	2030	2035	2040
Natural Gas Plants	62.5	55.9	15.5	20.6	17.1	15.6	15.5
Hydro Plants	23.1	65.3	91.5	121.4	141.9	159.7	177.7
New Coal Power plant 1000MW	-	50.5	47.3	70.6	110.2	165.5	256.6
New Coal Power plant 500MW	-	25.2	23.6	23.5	44.1	72.4	118.4
New Nuclear Plant	-	-	63.8	95.4	148.8	223.4	346.5
New Small Hydro	-	-	-	-	-	-	-
Solar PV	-	-	-	-	-	-	-
Biomass Plant	-	-	-	-	-	-	-
Wind Plants	-	-	-	-	-	-	-
Total	85.6	197.0	241.6	331.5	462.2	636.7	914.7